


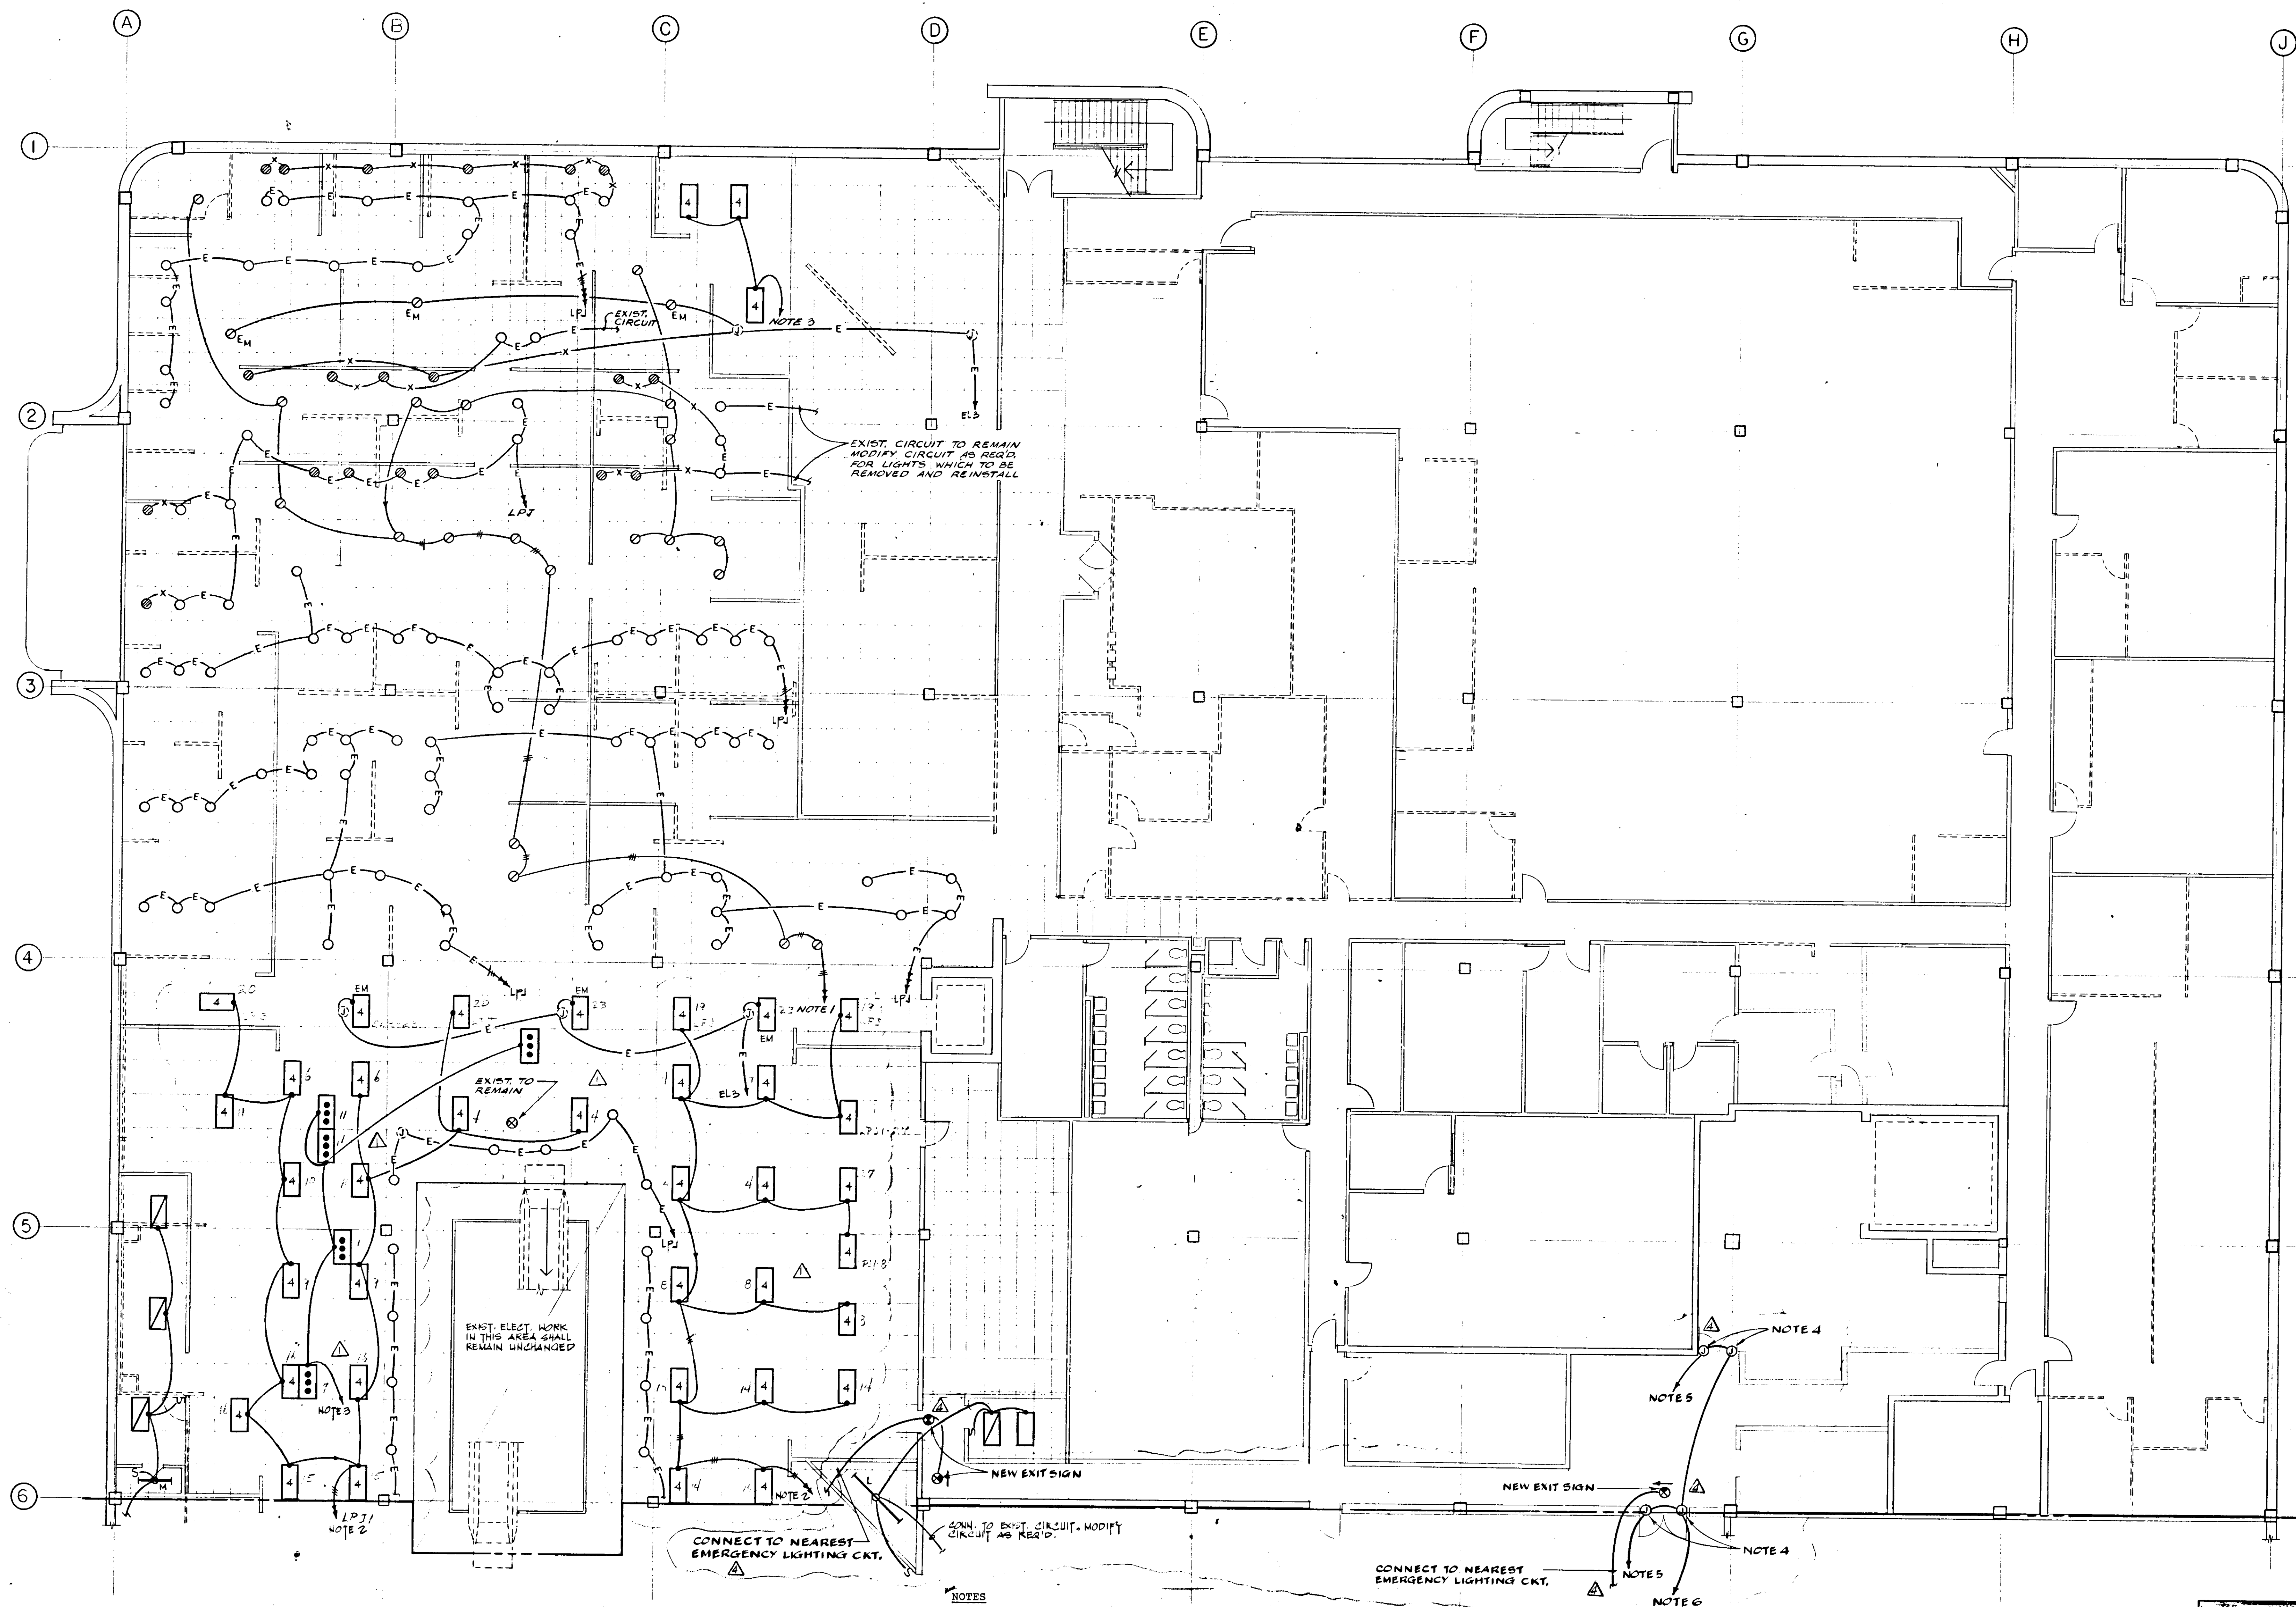

SECOND FLOOR - LIGHTING
SCALE: 1/8"=1'-0"

- NOTES
1. CONNECT TO 2-1P-20A SPARE CIRCUIT BREAKERS IN EXISTING PANEL "LPJ" RUN 3 #12 (BX) TO LIGHTS AS SHOWN ON PLAN.
 2. CONNECT TO 2-1P-20A SPARE CIRCUIT BREAKERS IN EXISTING PANEL "LPJ2", RUN 3 #12 (BX) TO LIGHTS AS SHOWN ON PLAN.
 3. CONNECT TO 1-1P-20A SPARE CIRCUIT BREAKER IN EXISTING PANEL "LPJ2", RUN 2 #12 (BX) TO LIGHTS AS SHOWN ON PLAN.
 4. OUTLET FOR ELECTRICAL DOOR HOLDER CLOSERS SHALL BE AS MANUFACTURED BY SIMPLEX CAT. #20889535 (WITHOUT DETECTOR).
OUTLET FOR ELECTRICAL DOOR HOLDER CLOSERS SHALL BE AS MANUFACTURED BY SIMPLEX CAT. #20889537 (WITH DETECTOR).
 5. EXTEND 3/4" CONDUIT TO FIRE ALARM CONTROL PANEL, CONDUCTORS AS RECOMMENDED BY EQUIPMENT MANUFACTURER.
 6. CONNECT TO 1-1P-20A SPARE CIRCUIT BREAKER IN EXISTING EMERGENCY PANEL "ELJ", RUN 2 #12 IN 3/4" CONDUIT TO DEVICES AS SHOWN.

ISSUED		REVISIONS	
DATE	BY	NO.	DESCRIPTION
12/24/54	W. J. H. E.	1	REV. LIGHTING FIX. TYPE
12/25/54	W. J. H. E.	2	GENERAL REVISION
12/25/54	W. J. H. E.	3	FIRE ALARM CONTROL
12/25/54	W. J. H. E.	4	GENERAL REVISION
12/25/54	W. J. H. E.	5	GENERAL REVISION
12/25/54	W. J. H. E.	6	GENERAL REVISION
12/25/54	W. J. H. E.	7	GENERAL REVISION
12/25/54	W. J. H. E.	8	GENERAL REVISION
12/25/54	W. J. H. E.	9	GENERAL REVISION
12/25/54	W. J. H. E.	10	GENERAL REVISION

SHEET TITLE: SECOND FLOOR - LIGHTING (QUADRANT 5)

SEARS

SEARS, ROEBUCK AND CO.
ALTERATIONS AND ADDITIONS TO
RETAIL STORE
SECURITY SQUARE, BALTIMORE, MD.

FEDCO SYSTEMS INC.
10905 FT. WASHINGTON ROAD
FORT WASHINGTON MARYLAND 20744
292-3900 645-3337
ARCHITECTS - ENGINEERS - PLANNERS - SURVEYORS

ELECTRONIC CONTROL
R1224 112 E10

E-10
PROJECT NO. 531-2