



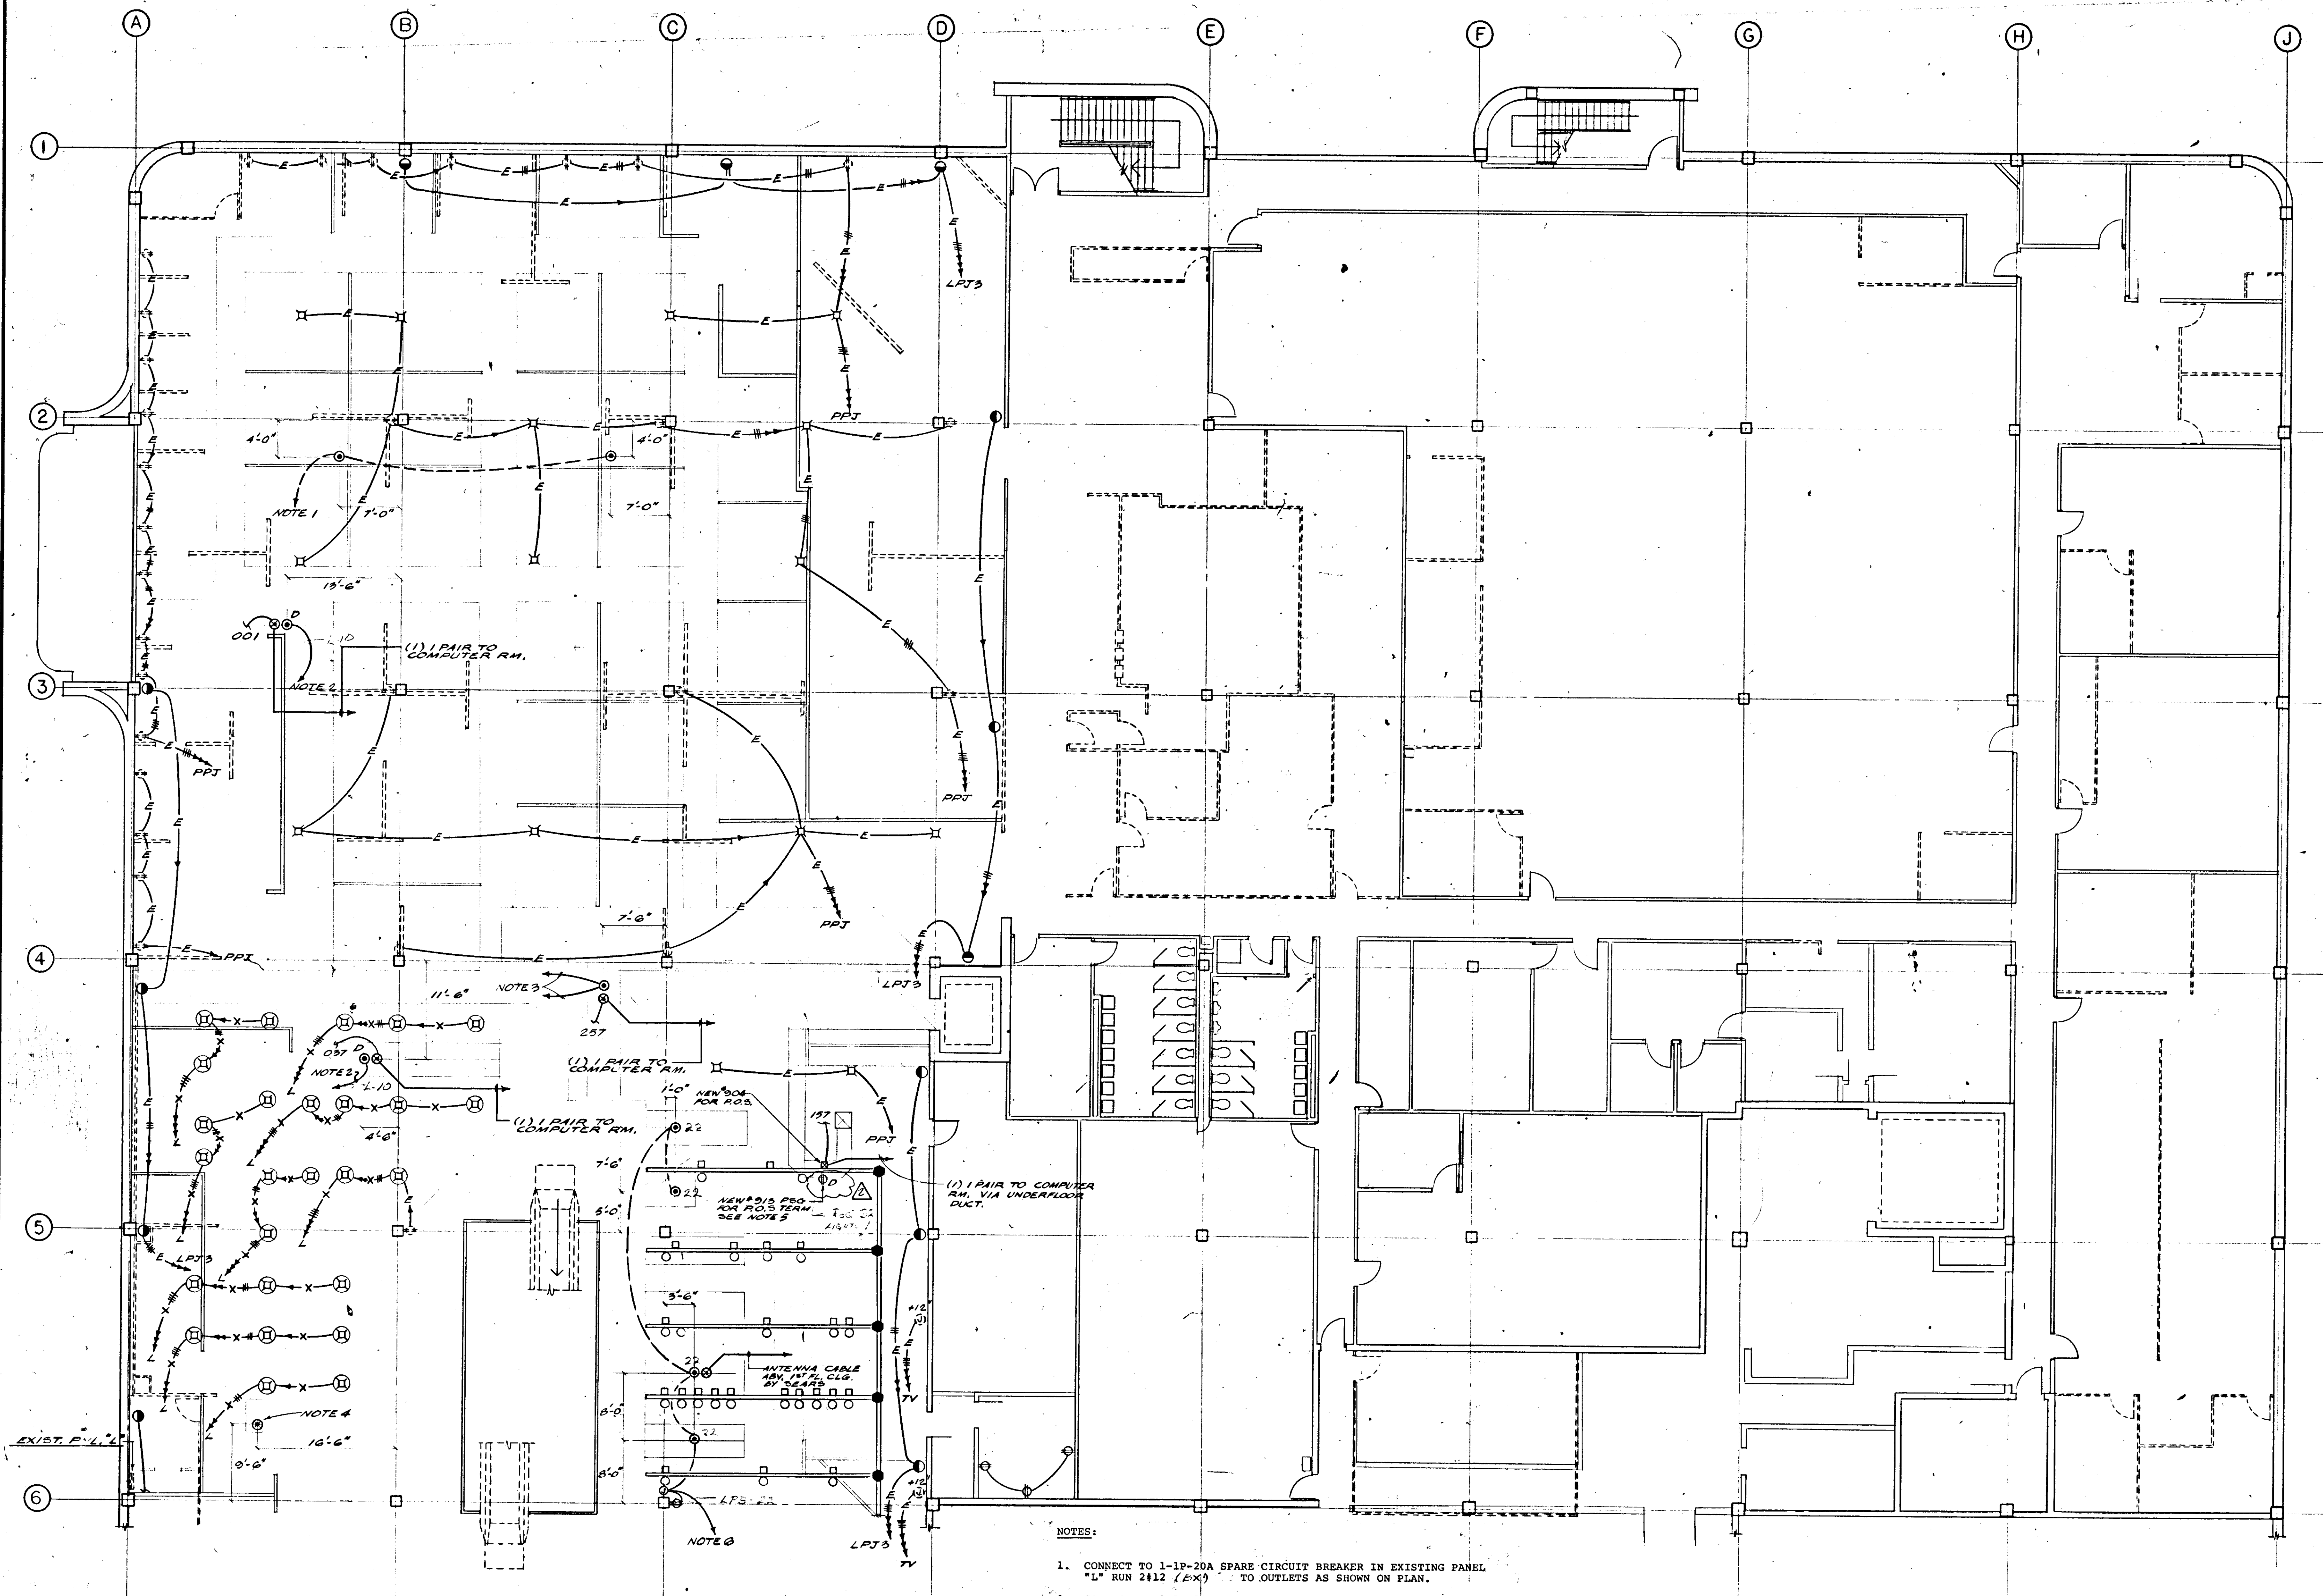

SECOND FLOOR-POWER
SCALE: 1/8"=1'-0"

- NOTES:
1. CONNECT TO 1-1P-20A SPARE CIRCUIT BREAKER IN EXISTING PANEL "L" RUN 2 #12 (BX) TO OUTLETS AS SHOWN ON PLAN.
 2. CONNECT TO 1-1P-20A SPARE CIRCUIT BREAKER IN EXISTING PANEL "L" RUN 2 #12 (BX) TO OUTLET.
 3. CONNECT TO 2-1P-20A SPARE CIRCUIT BREAKER IN EXISTING PANEL "L" RUN (TWO) 2 #12 + GROUND (BX) TO OUTLET.
 4. 3/4" E.C. STUBBED INTO CEILING SPACE BELOW FOR TELEPHONE CABLE.
 5. CONTRACTOR TO FURNISH AND INSTALL AFTER SET INSERT AND NEW #12 PSC, CONNECT NEW OUTLET TO SPARE CIRCUIT BREAKER IN EXISTING PANEL "TV", PULL CONDUCTORS THRU UNDER FLOOR DUCT AND CONNECT TO OUTLET AS REQUIRED.
 6. CONTRACTOR TO FURNISH AND INSTALL 1-1P-20A CIRCUIT BREAKER IN EXISTING SPACE IN EXISTING PANEL "PPT" RUN 2 #12 (BX) TO OUTLETS AS SHOWN

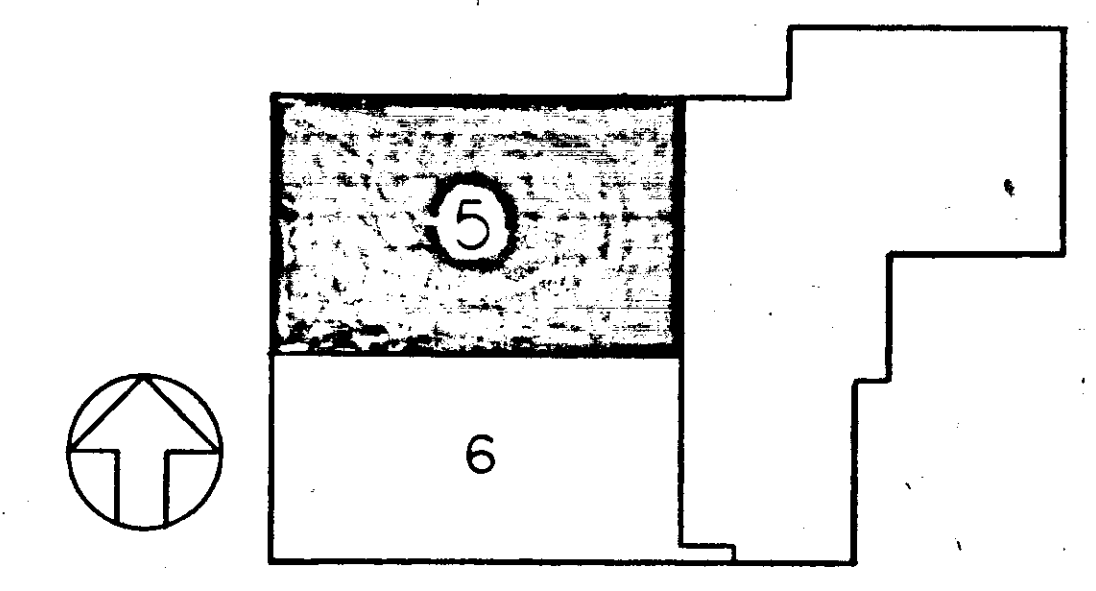

ISSUED		REVISIONS	
7/27/85		7/27/85	
1/28/85		1/28/85	
DATE		DATE	
DRAWN		CHECKED	
PROJECT NO. 531-2		PROJECT NO. 531-2	

SHEET TITLE: SECOND FLOOR - POWER (QUADRANT 5)

SEARS

SEARS, ROEBUCK AND CO.
ALTERATIONS AND ADDITIONS TO
RETAIL STORE
SECURITY SQUARE, BALTIMORE, MD.

FEDCO SYSTEMS INC.
10905 FT. WASHINGTON ROAD
FORT WASHINGTON MARYLAND 20744
292-3500 645-3337
ARCHITECTS - ENGINEERS - PLANNERS - SURVEYORS

ELECTRONIC CONTROL
R1634 114 E12

E-12