



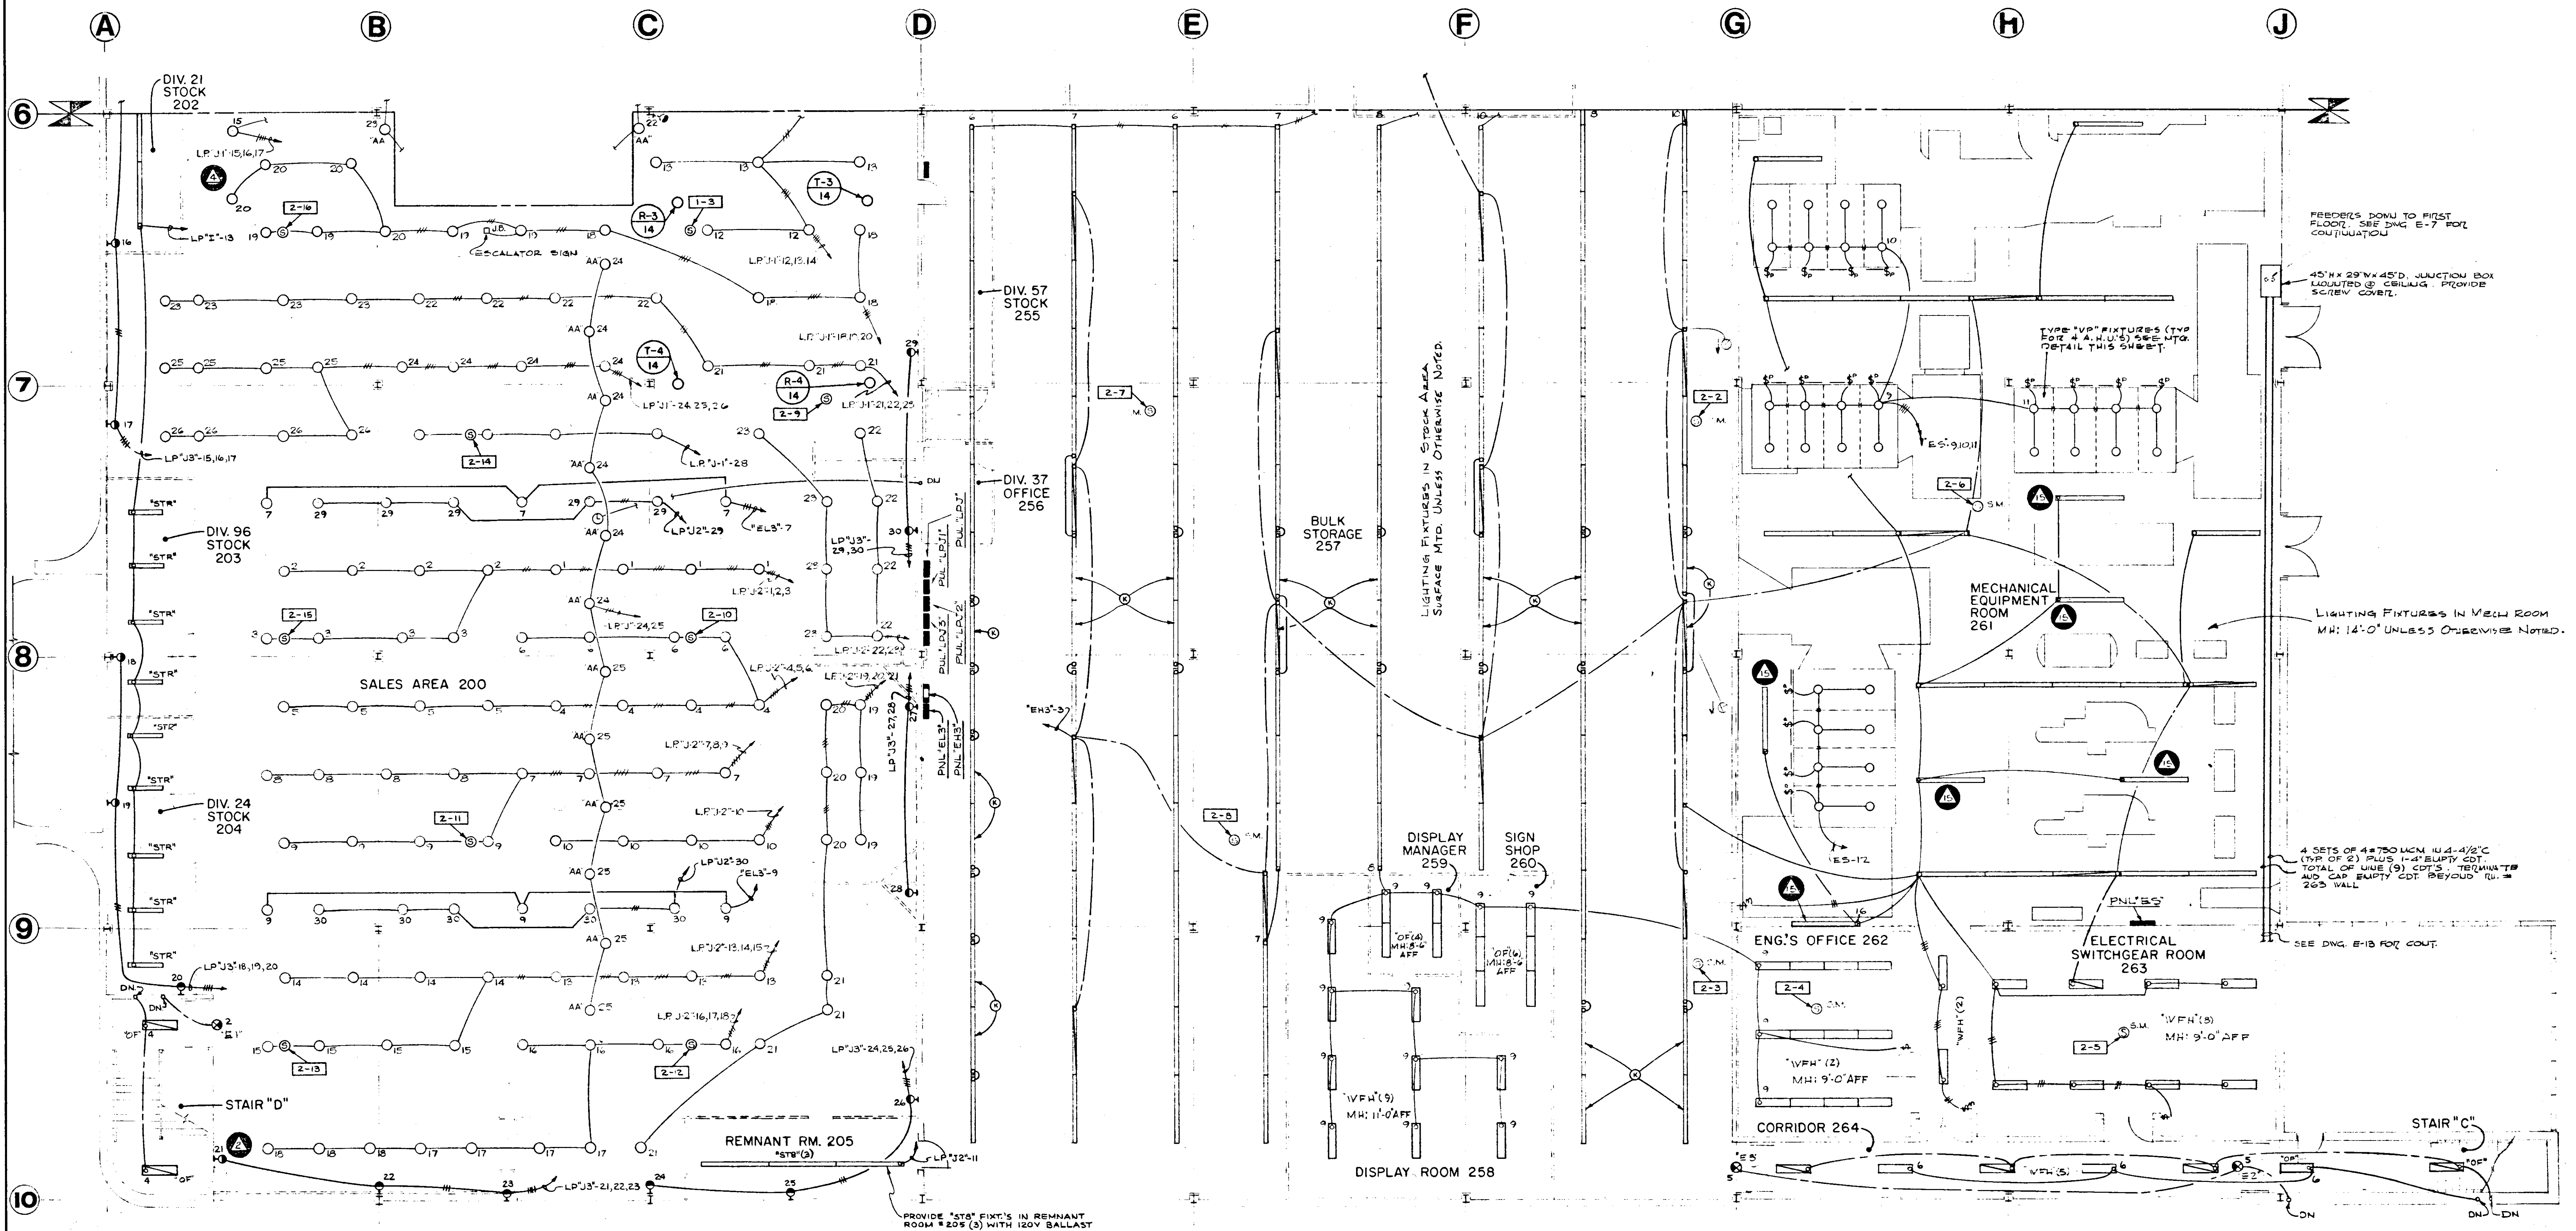


NOTES:

1. ALL 8'-0" FLUORESCENT LIGHTING FIXTURES SHALL BE TYPE "STR" UNLESS OTHERWISE NOTED.
2. ALL RECESSED INCANDESCENT FIXTURES ON THIS FLOOR SHALL BE TYPE "D" UNLESS OTHERWISE NOTED.
3. EXACT LOCATION OF TYPE "VP" LIGHTING FIXTURE IN AIR HANDLING UNIT ENCLOSURES SHALL BE COORDINATED WITH UNIT SUPPLIER. FIXTURES SHALL BE FURNISHED AND INSTALLED BY ELECTRICAL CONTRACTOR.

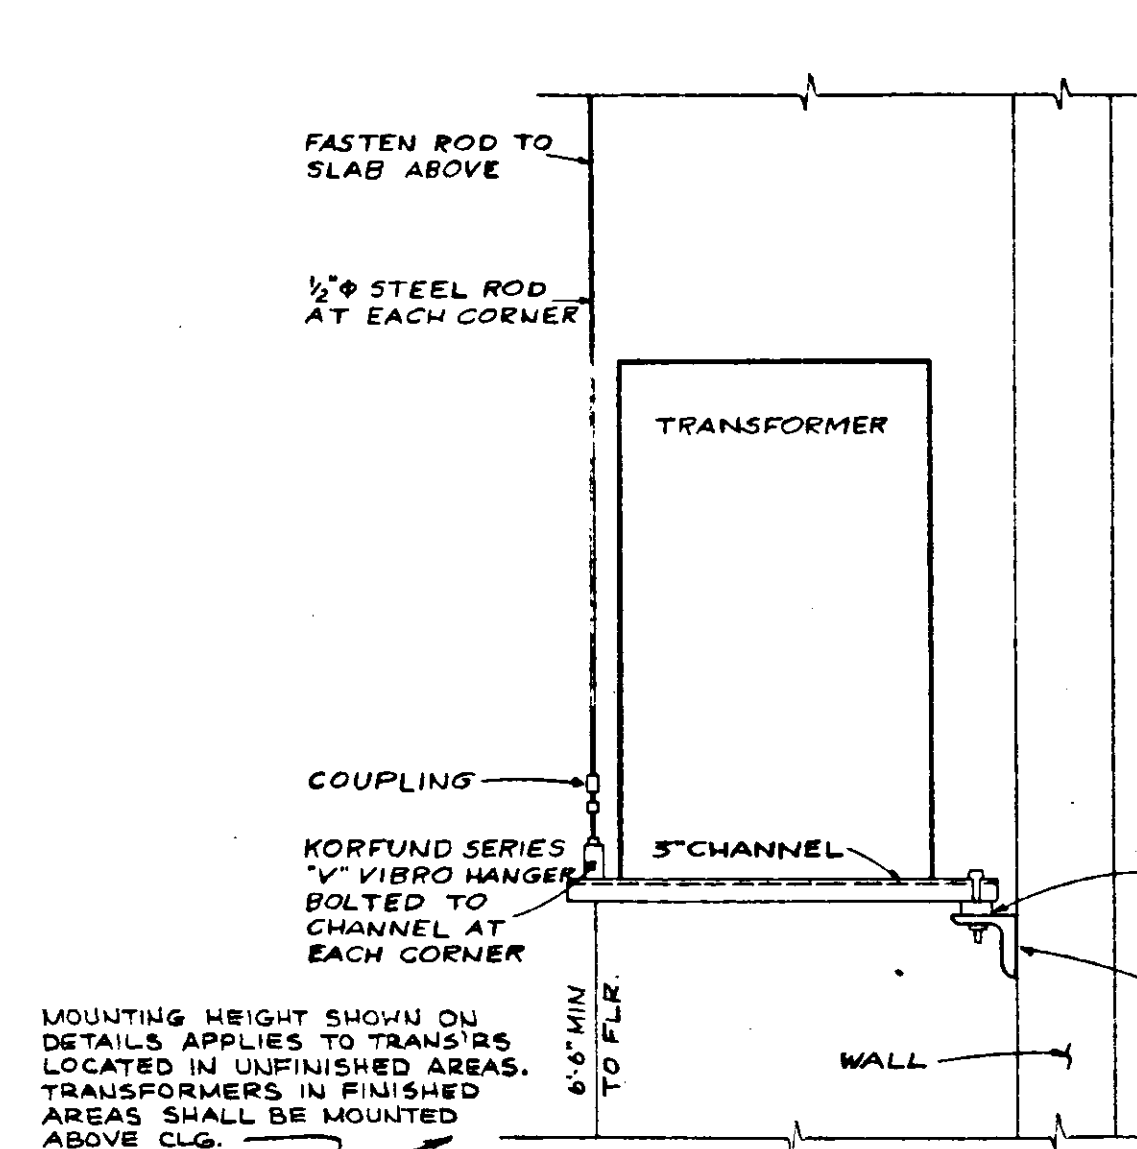


OVER 20 KVA

DRY-TYPE XFMR. MOUNTING DETAIL
NO SCALE

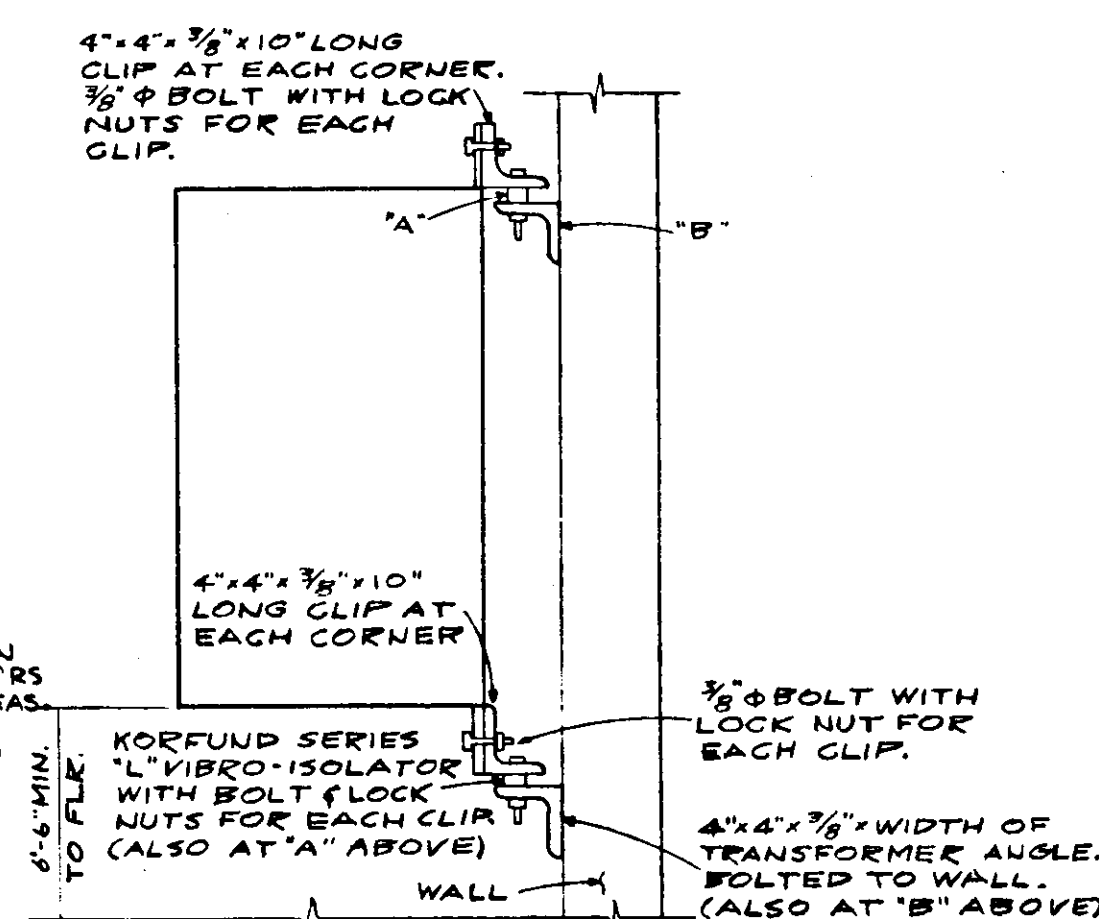

20 KVA AND BELOW

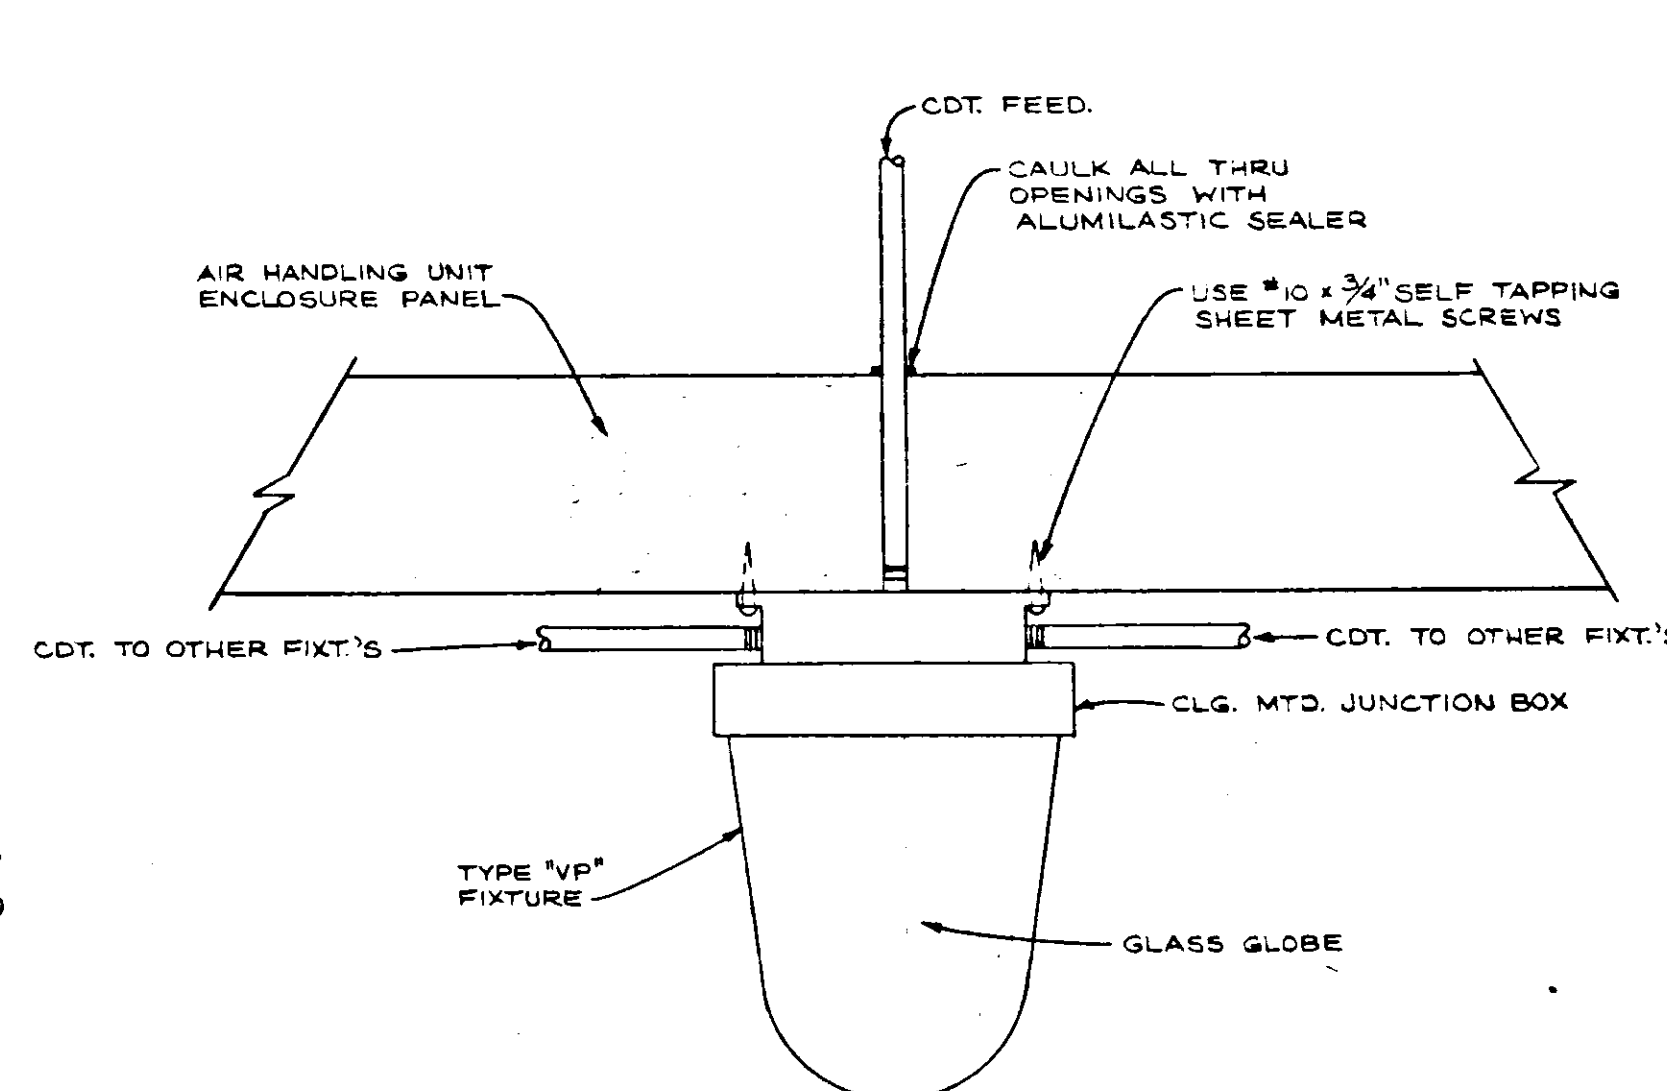

TYPE "VP" MOUNTING DETAIL
NO SCALE

ELECTRONIC CONTROL #
R1634 QZ6 E12

OCT. 20, 1972

MARCH 7, 1972 NOV. 1, 1971