


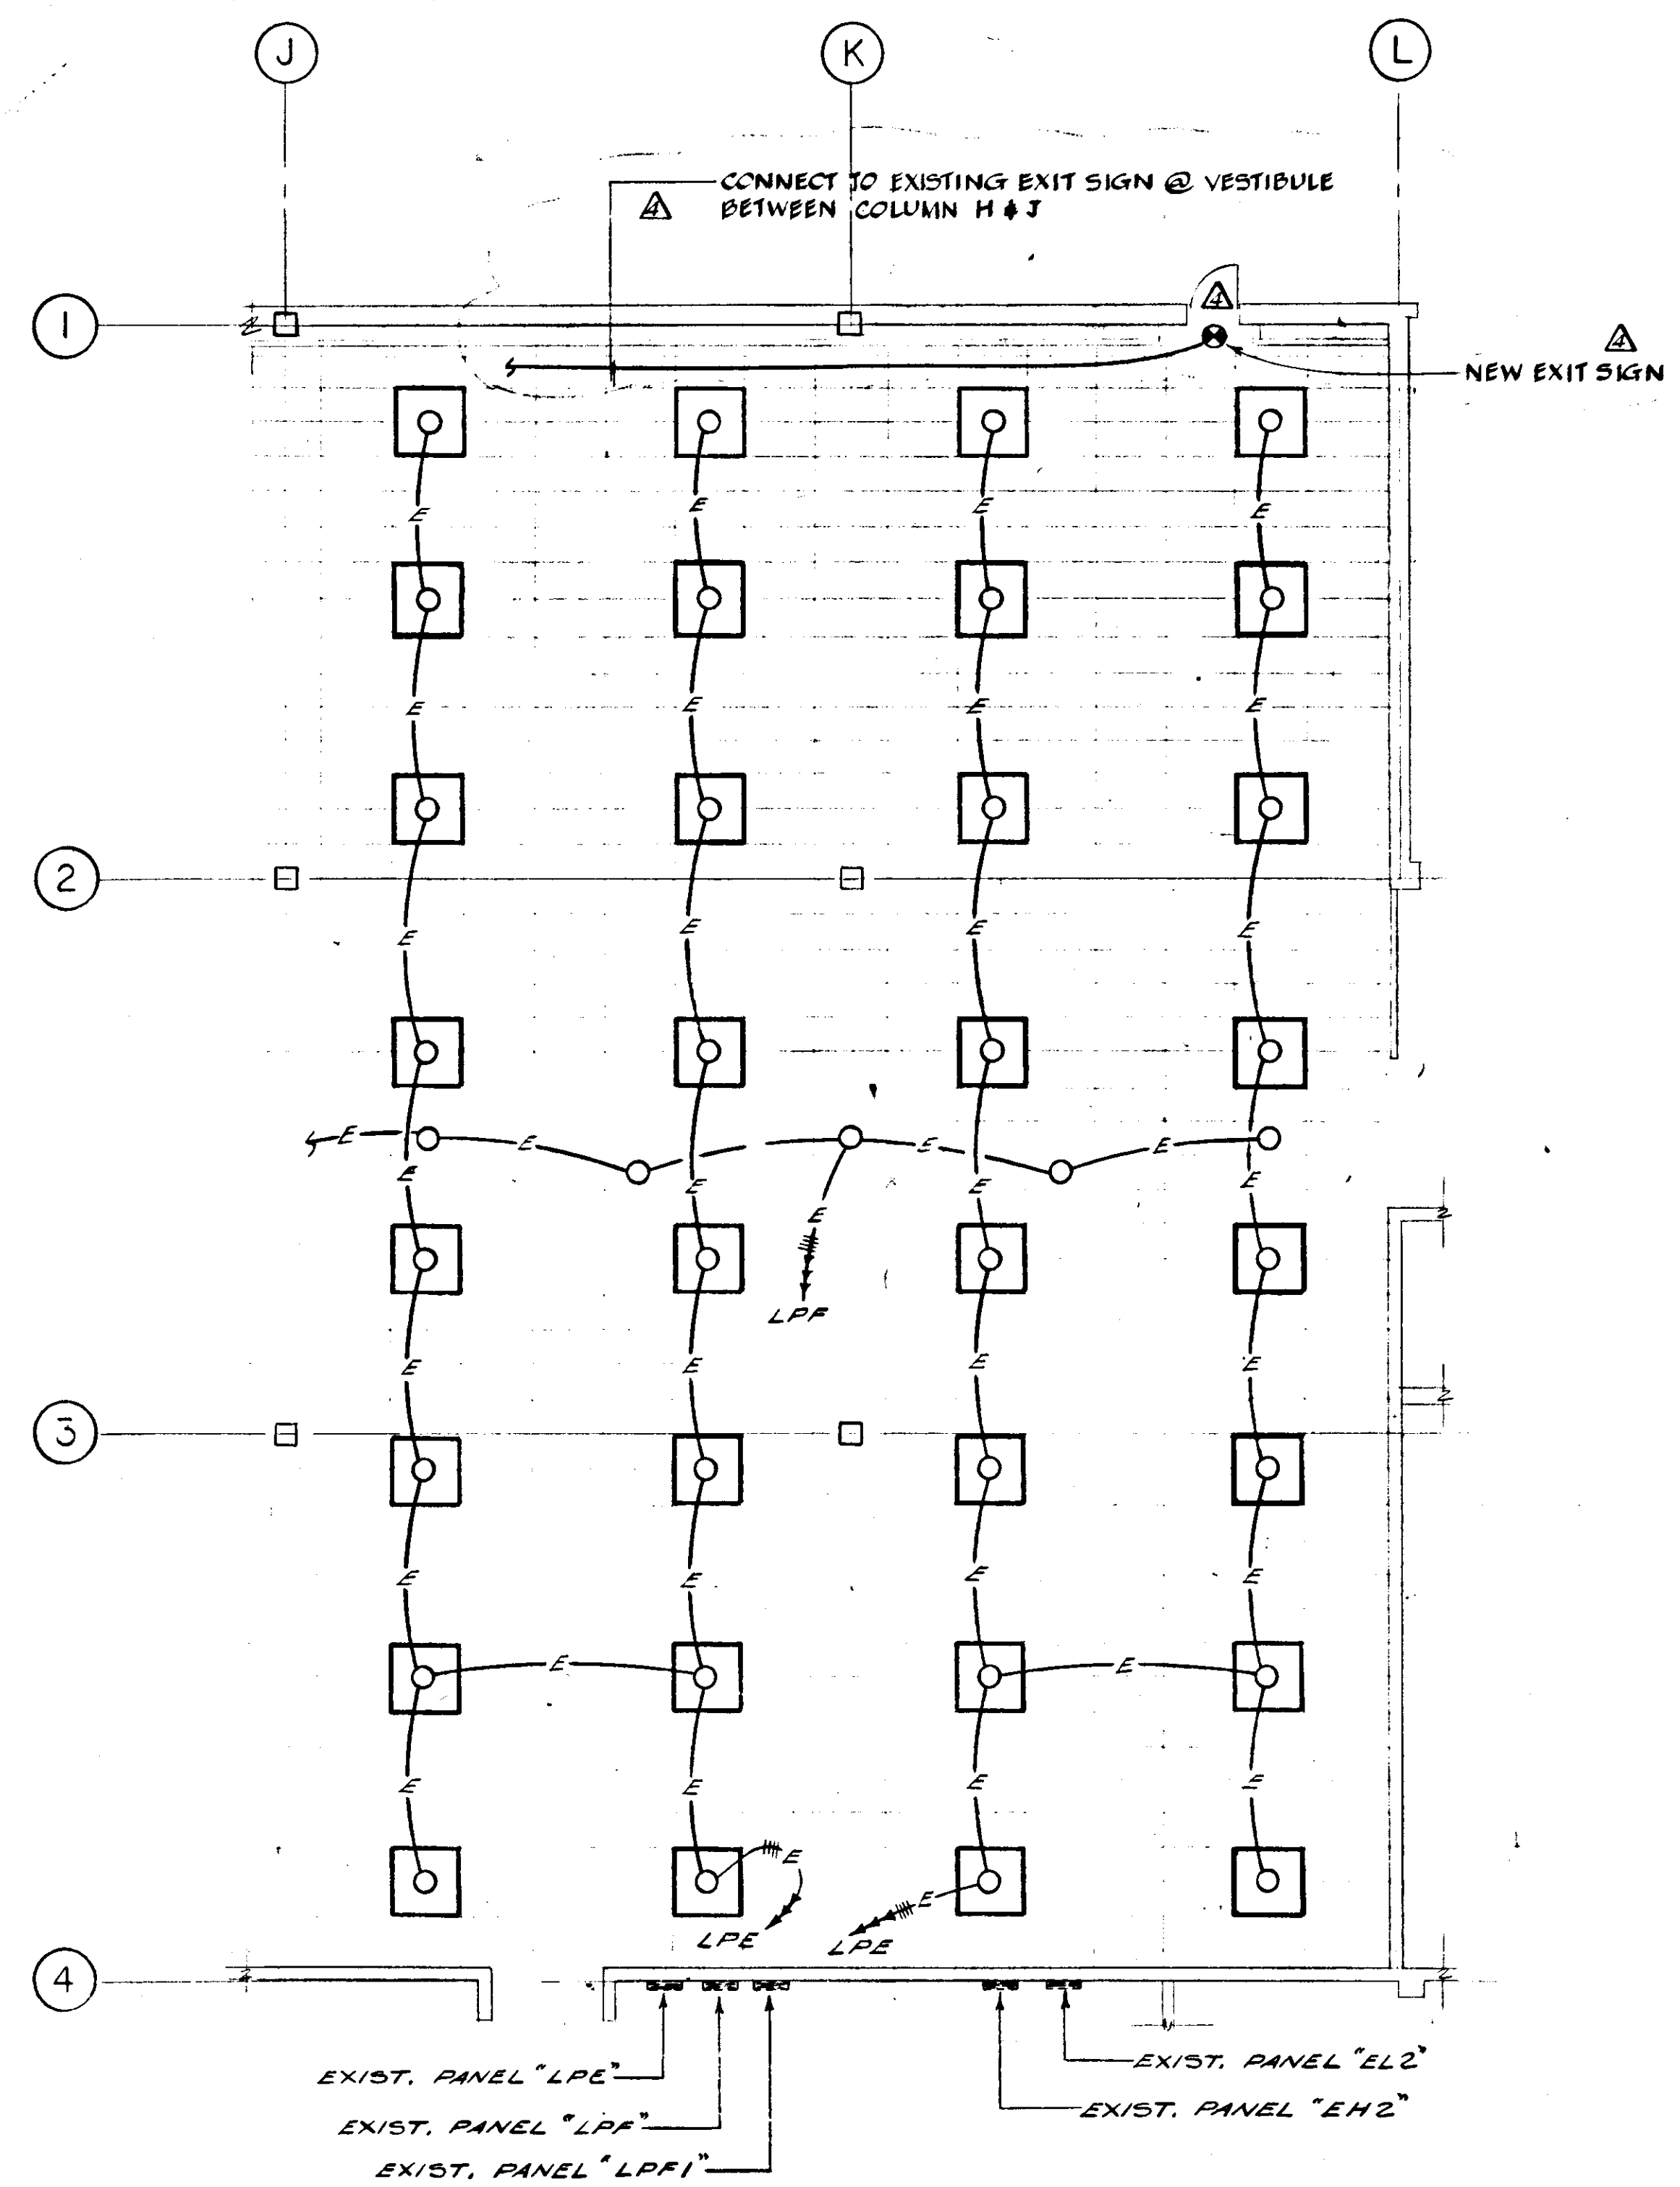



FIRST FLOOR - LIGHTING

SCALE: 1/8"=1'-0"

NOTE:

- ALL EMERGENCY LIGHTING IN THIS AREA TO REMAIN UNCHANGED, WHERE EXISTING EMERGENCY LIGHTS TO BE REMOVED DUE TO ALTERATION FOR NEW WORK, CONTRACTOR TO MODIFY EXISTING EMERGENCY LIGHTING CIRCUIT IN THE AREA AS REQUIRED FOR CONTINUITY OF CIRCUITS.

PANEL DESIGNATION	VOLTAGE	LUCS	MAINS CIRCUIT BRK	TOTAL NUMBER OF CIRCUIT BRK AVAIL.	*MARK ACTIVE	(SPARES)	SPACES
LPA	277/480V	100A	90A	22	17	5	-
LPB	120/208V	100A	M.L.O.	40	32	8	2
LPB1	120/208V	100A	M.L.O.	26	25	1	4
LPB2	120/208V	100A	M.L.O.	42	36	6	-
LPC	277/480V	100A	40A	13	13	-	11
LPD	120/208V	100A	100A	36	28	8	6
LPD1	120/208V	225A	125A	42	36	6	-
LPD2	120/208V	100A	100A	35	29	6	7
LPE	277/480V	100A	60A	19	19	-	5
LPF	120/208V	100A	40A	12	5	7	-
LPF1	120/208V	100A	70A	30	26	4	8
LPG	277/480V	100A	40A	15	12	3	9
LPJ	120/208V	225A	M.L.O.	42	32	10	-
LPJ1	120/208V	100A	M.L.O.	42	33	9	-
LPJ2	120/208V	100A	M.L.O.	42	29	13	-
LPJ3	120/208V	100A	M.L.O.	42	31	11	-
CL	120/208V	100A	M.L.O.	42	42	-	-
PPA	120/208V	100A	M.L.O.	42	31	11	-
PPA1	120/208V	100A	M.L.O.	42	37	5	-
PPA2	120/208V	225A	M.L.O.	14	14	-	10
PPC	120/208V	100A	40A	22	22	-	2
PPD	120/208V	100A	70A	33	31	2	3
PPG	120/208V	100A	70A	31	29	2	4
PPJ	120/208V	100A	M.L.O.	26	26	-	16
TV	120/208V	100A	90A	36	36	-	6
L	120/208V	100A	100A	36	27	9	-
PPB	277/480V	225A	125A	15	8	7	3
PPF	277/480V	225A	175A	14	7	7	-
A	120/208V	225A	UNKNOWN	30	24	6	12
EH1	277/480V	60A	20A	9	5	4	-
EL3	120/208V	100A	70A	26	26	-	7

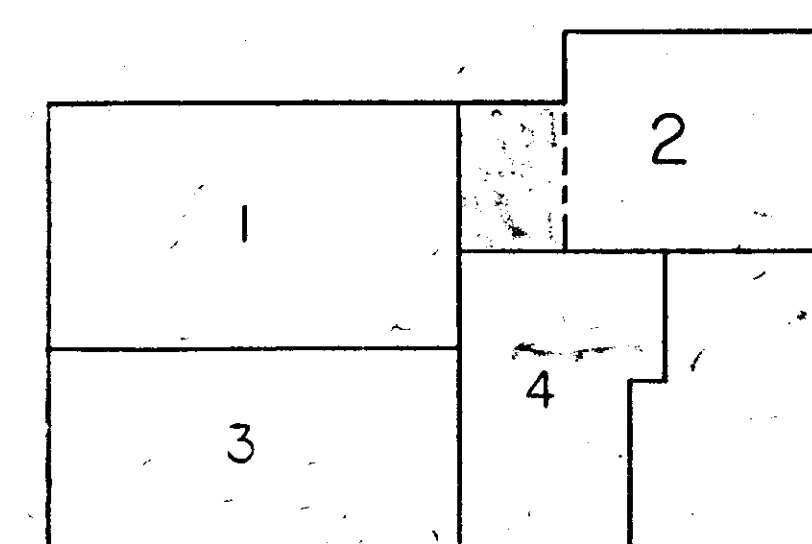

SHEET TITLE: FIRST FLOOR - LIGHTING (QUADRANT 2)

SEARS

SEARS, ROEBUCK AND CO.

ALTERATIONS AND ADDITIONS TO

RETAIL STORE

SECURITY SQUARE, BALTIMORE, MD.

FEDCO SYSTEMS INC.

10905 FT. WASHINGTON ROAD

FORT WASHINGTON MARYLAND 20744

292-3900 645-3337

ARCHITECTS - ENGINEERS - PLANNERS - SURVEYORS



SHEET NO.

E-3

PROJECT NO. 531-2

ELECTRONIC CONTROL
R1634 1.05 E3