
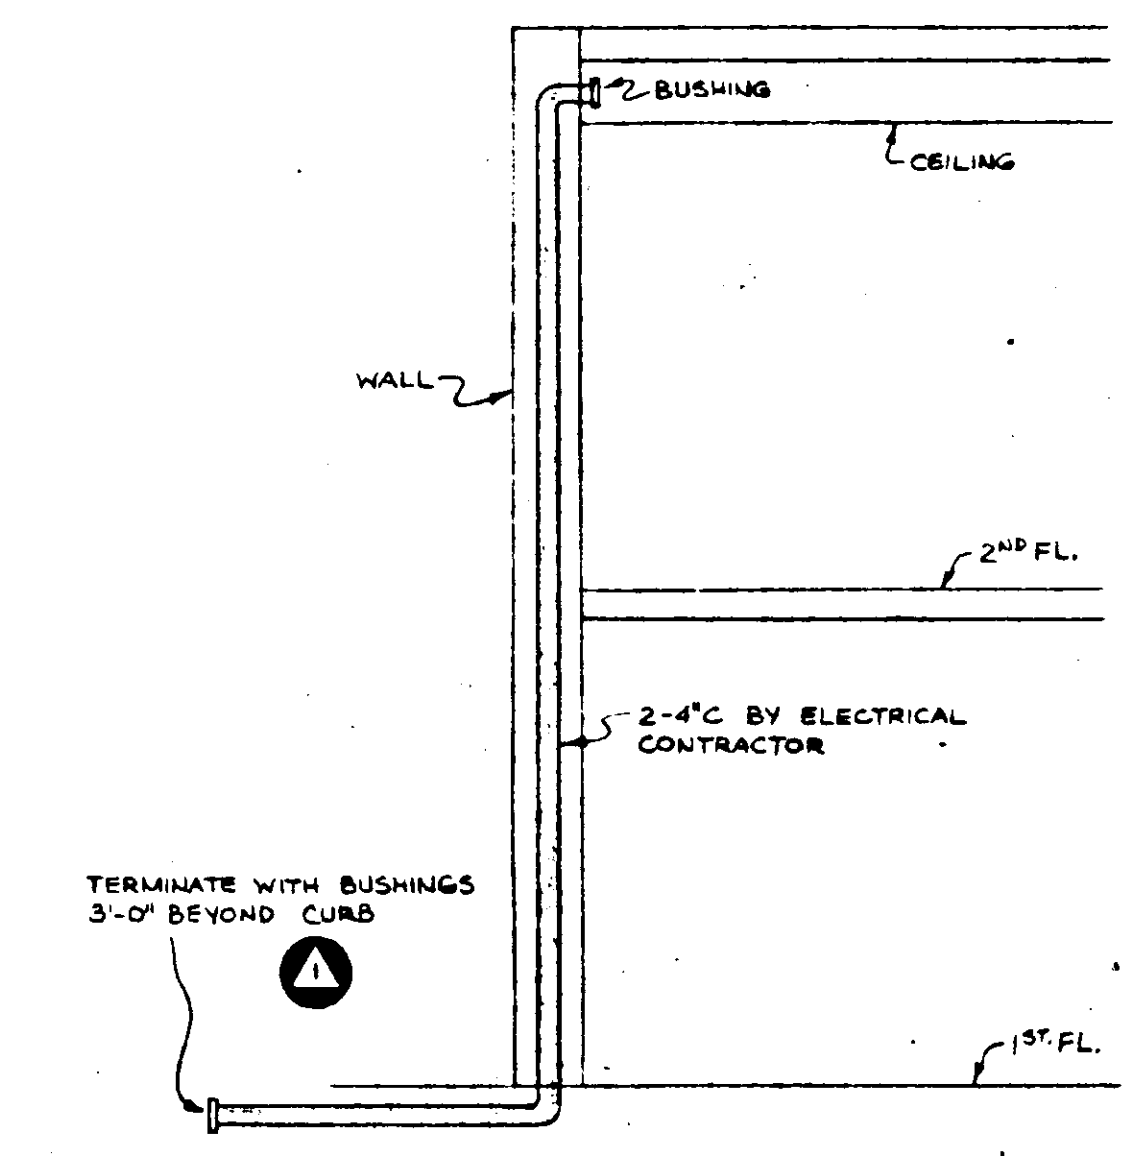


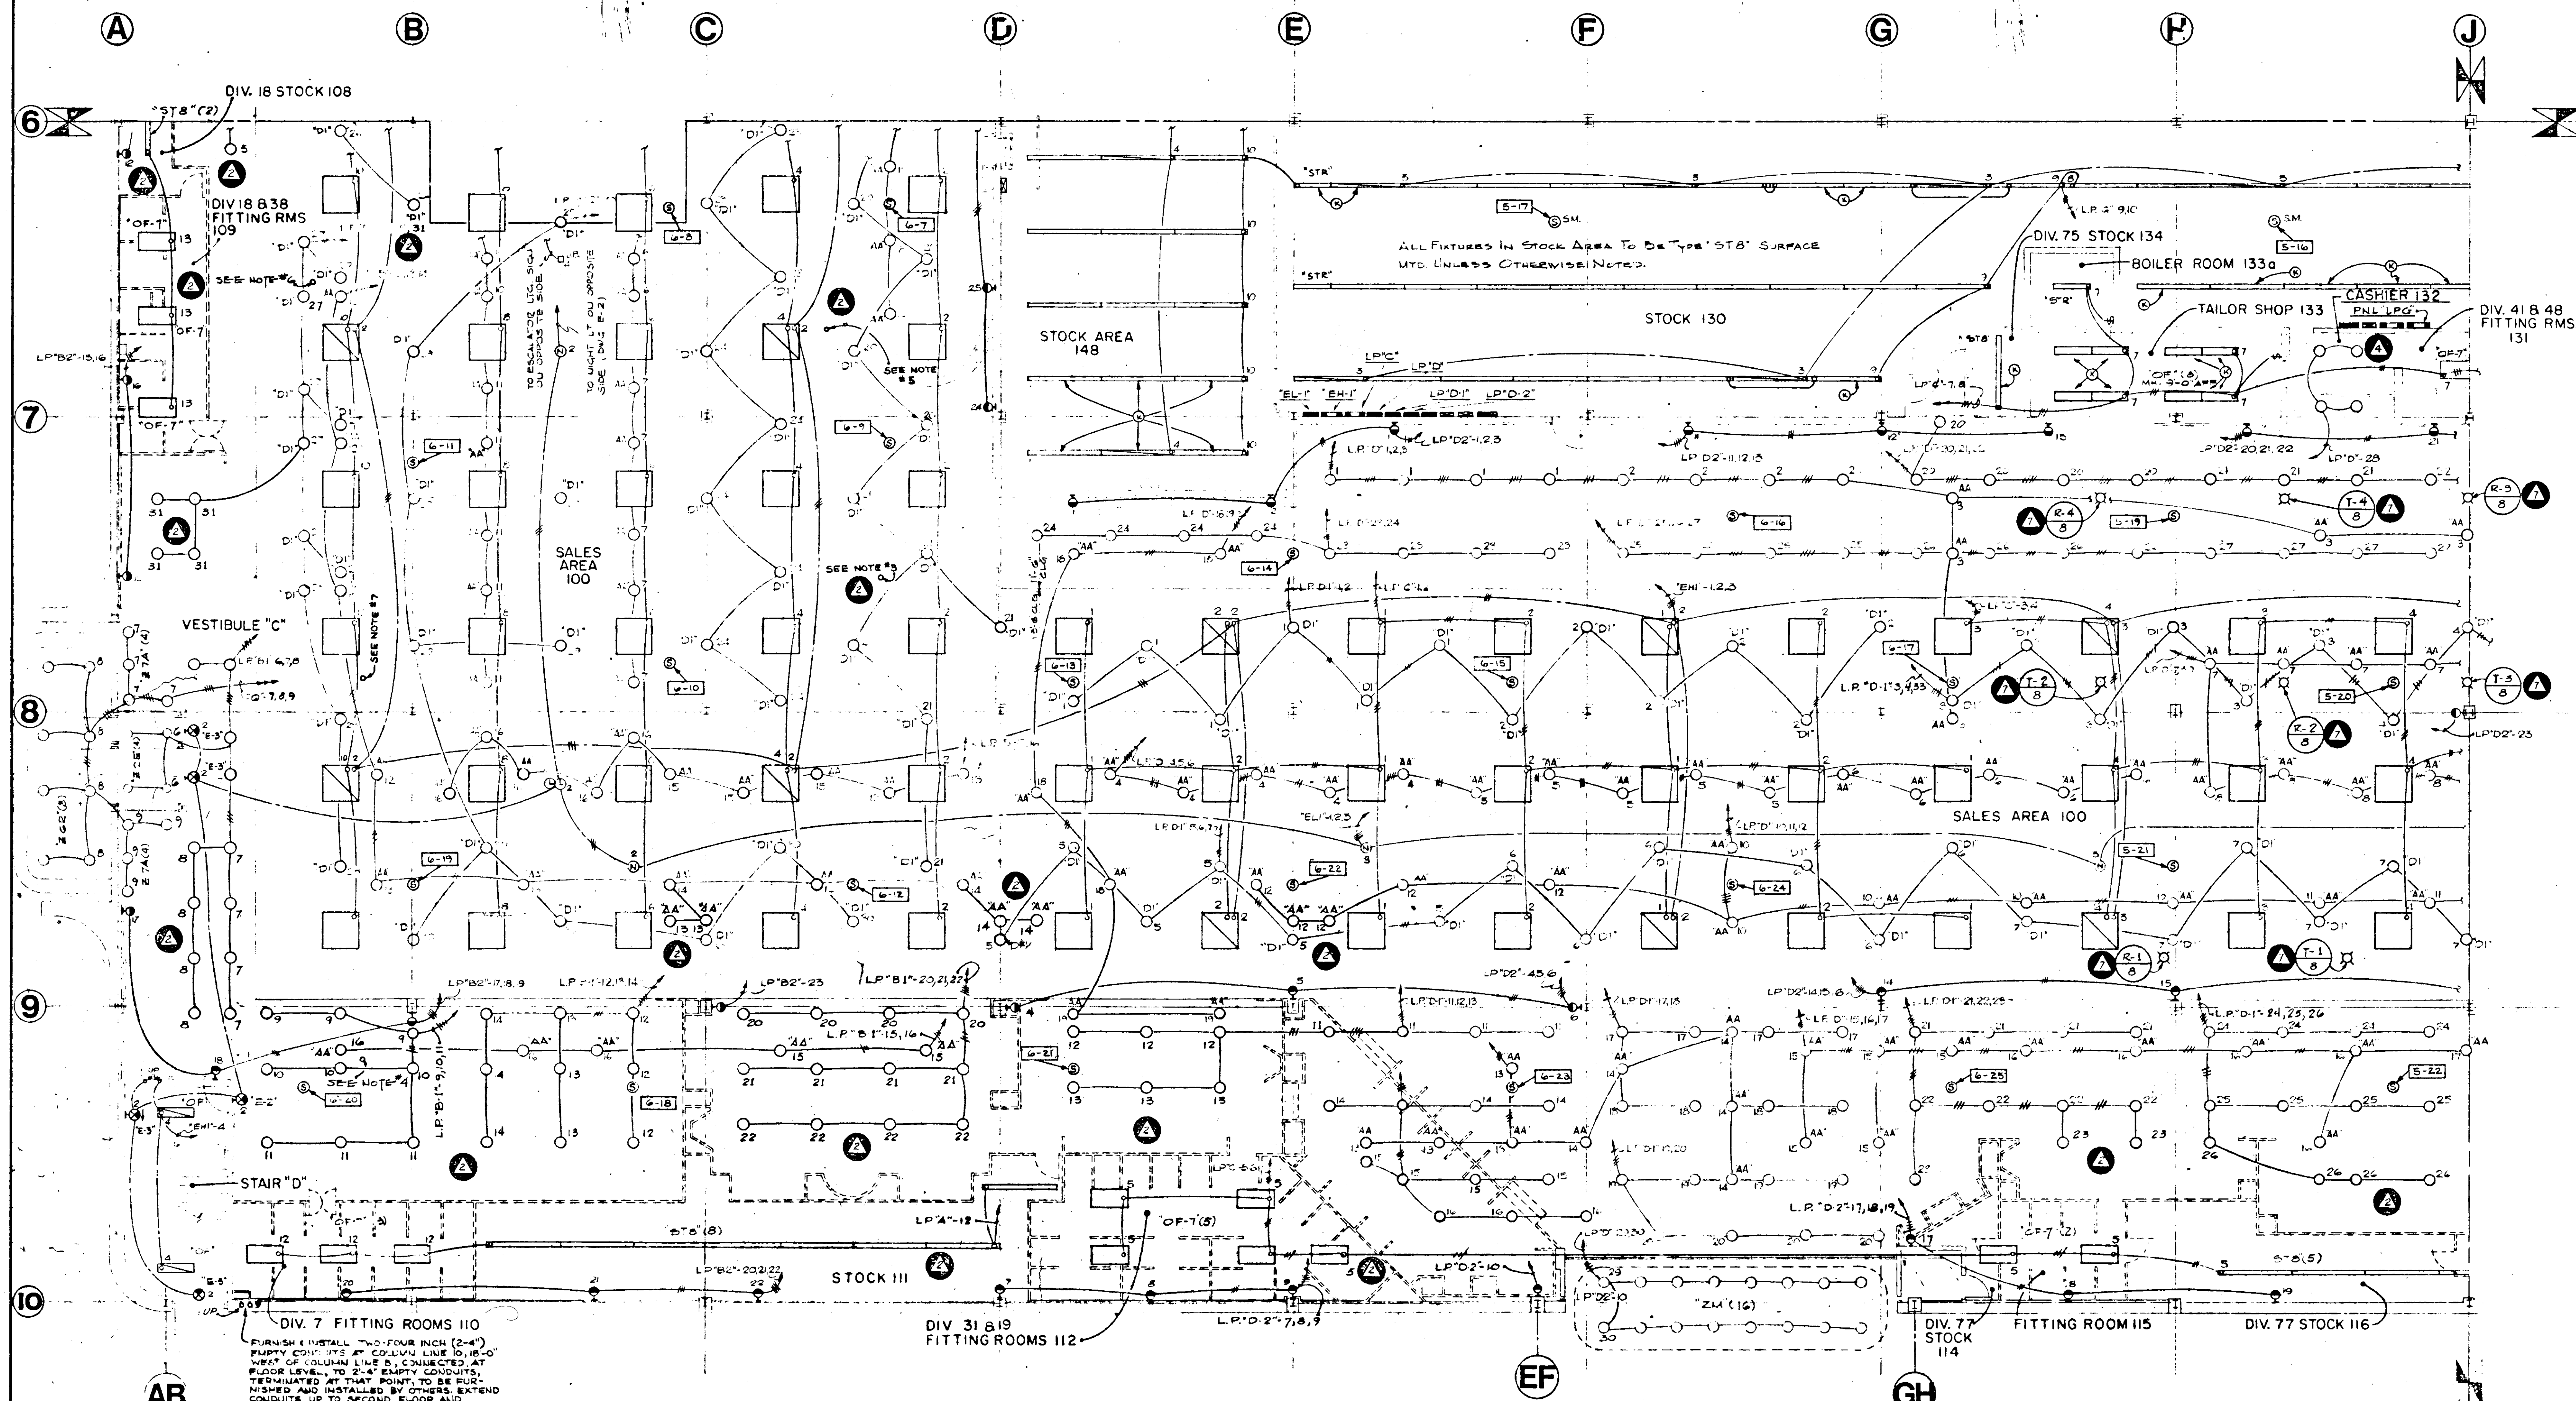

TELEPHONE CONDUITS - DETAIL
NO SCALE

- NOTES:
- 1. ALL 4"x4" FLUORESCENT FIXTURES ON THIS DWG. SHALL BE TYPE "A-1" UNLESS OTHERWISE NOTED.
 - 2. ALL RECESSED INCANDESCENT FIXTURES ON THIS DWG. SHALL BE TYPE "D" UNLESS OTHERWISE NOTED.
 - 3. 1-2/PR. COND. FROM TC#6 UP TO 6-7-0 & 1-2/PR. COND. FROM TC#11 UP TO 11-3-0 (ALL ABOVE CLG.).
 - 4. 1-2/PR. COND. FROM TC#6 UP TO 6-6-0 & 1-2/PR. COND. FROM TC#11 UP TO 11-2-0 (ALL ABOVE CLG.).
 - 5. 2/PR. COND. ABOVE CLG. FROM TC#6 UP TO 6-8-0.
 - 6. 1-2/PR. COND. FROM TC#6 UP TO 6-4-0 & 1-2/PR. COND. FROM TC#10 UP TO 10-5-0 (ALL ABOVE CLG.).
 - 7. 1-2/PR. COND. FROM TC#6 UP TO 6-5-0 & 1-2/PR. COND. FROM TC#11 UP TO 11-1-0 (ALL ABOVE CLG.).

- OCT. 20, 1972
- MAY 2, 1972
- MARCH 7, 1972
- NOV. 1, 1971
- OCT. 1, 1971

ELECTRONIC CONTROL #
R1634 D70 E6