
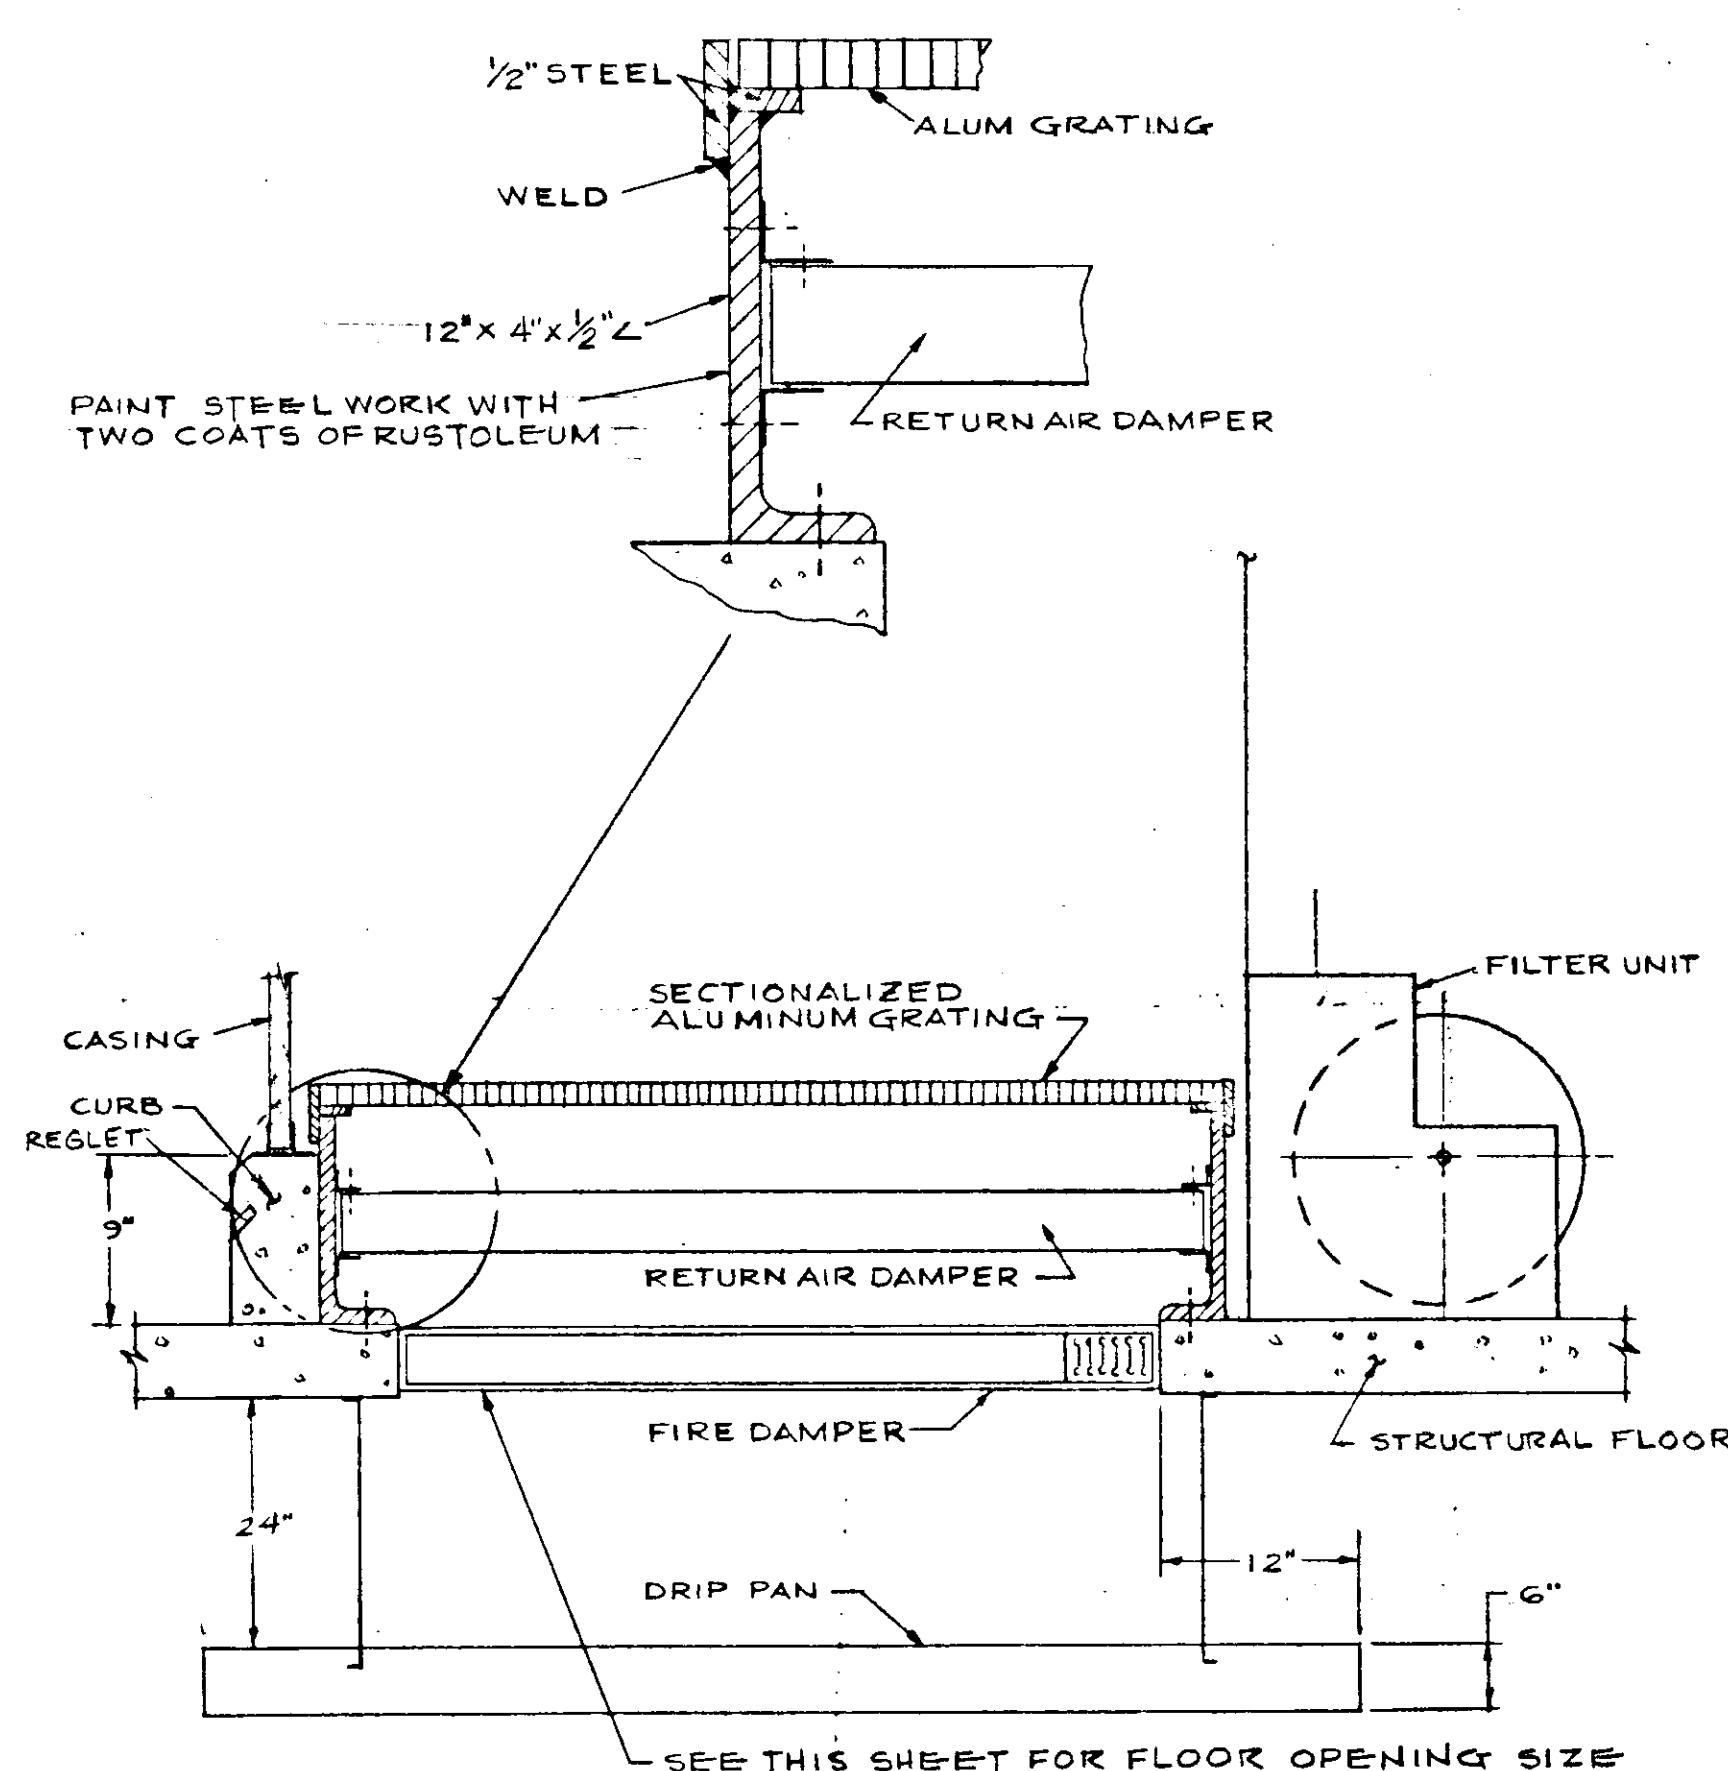
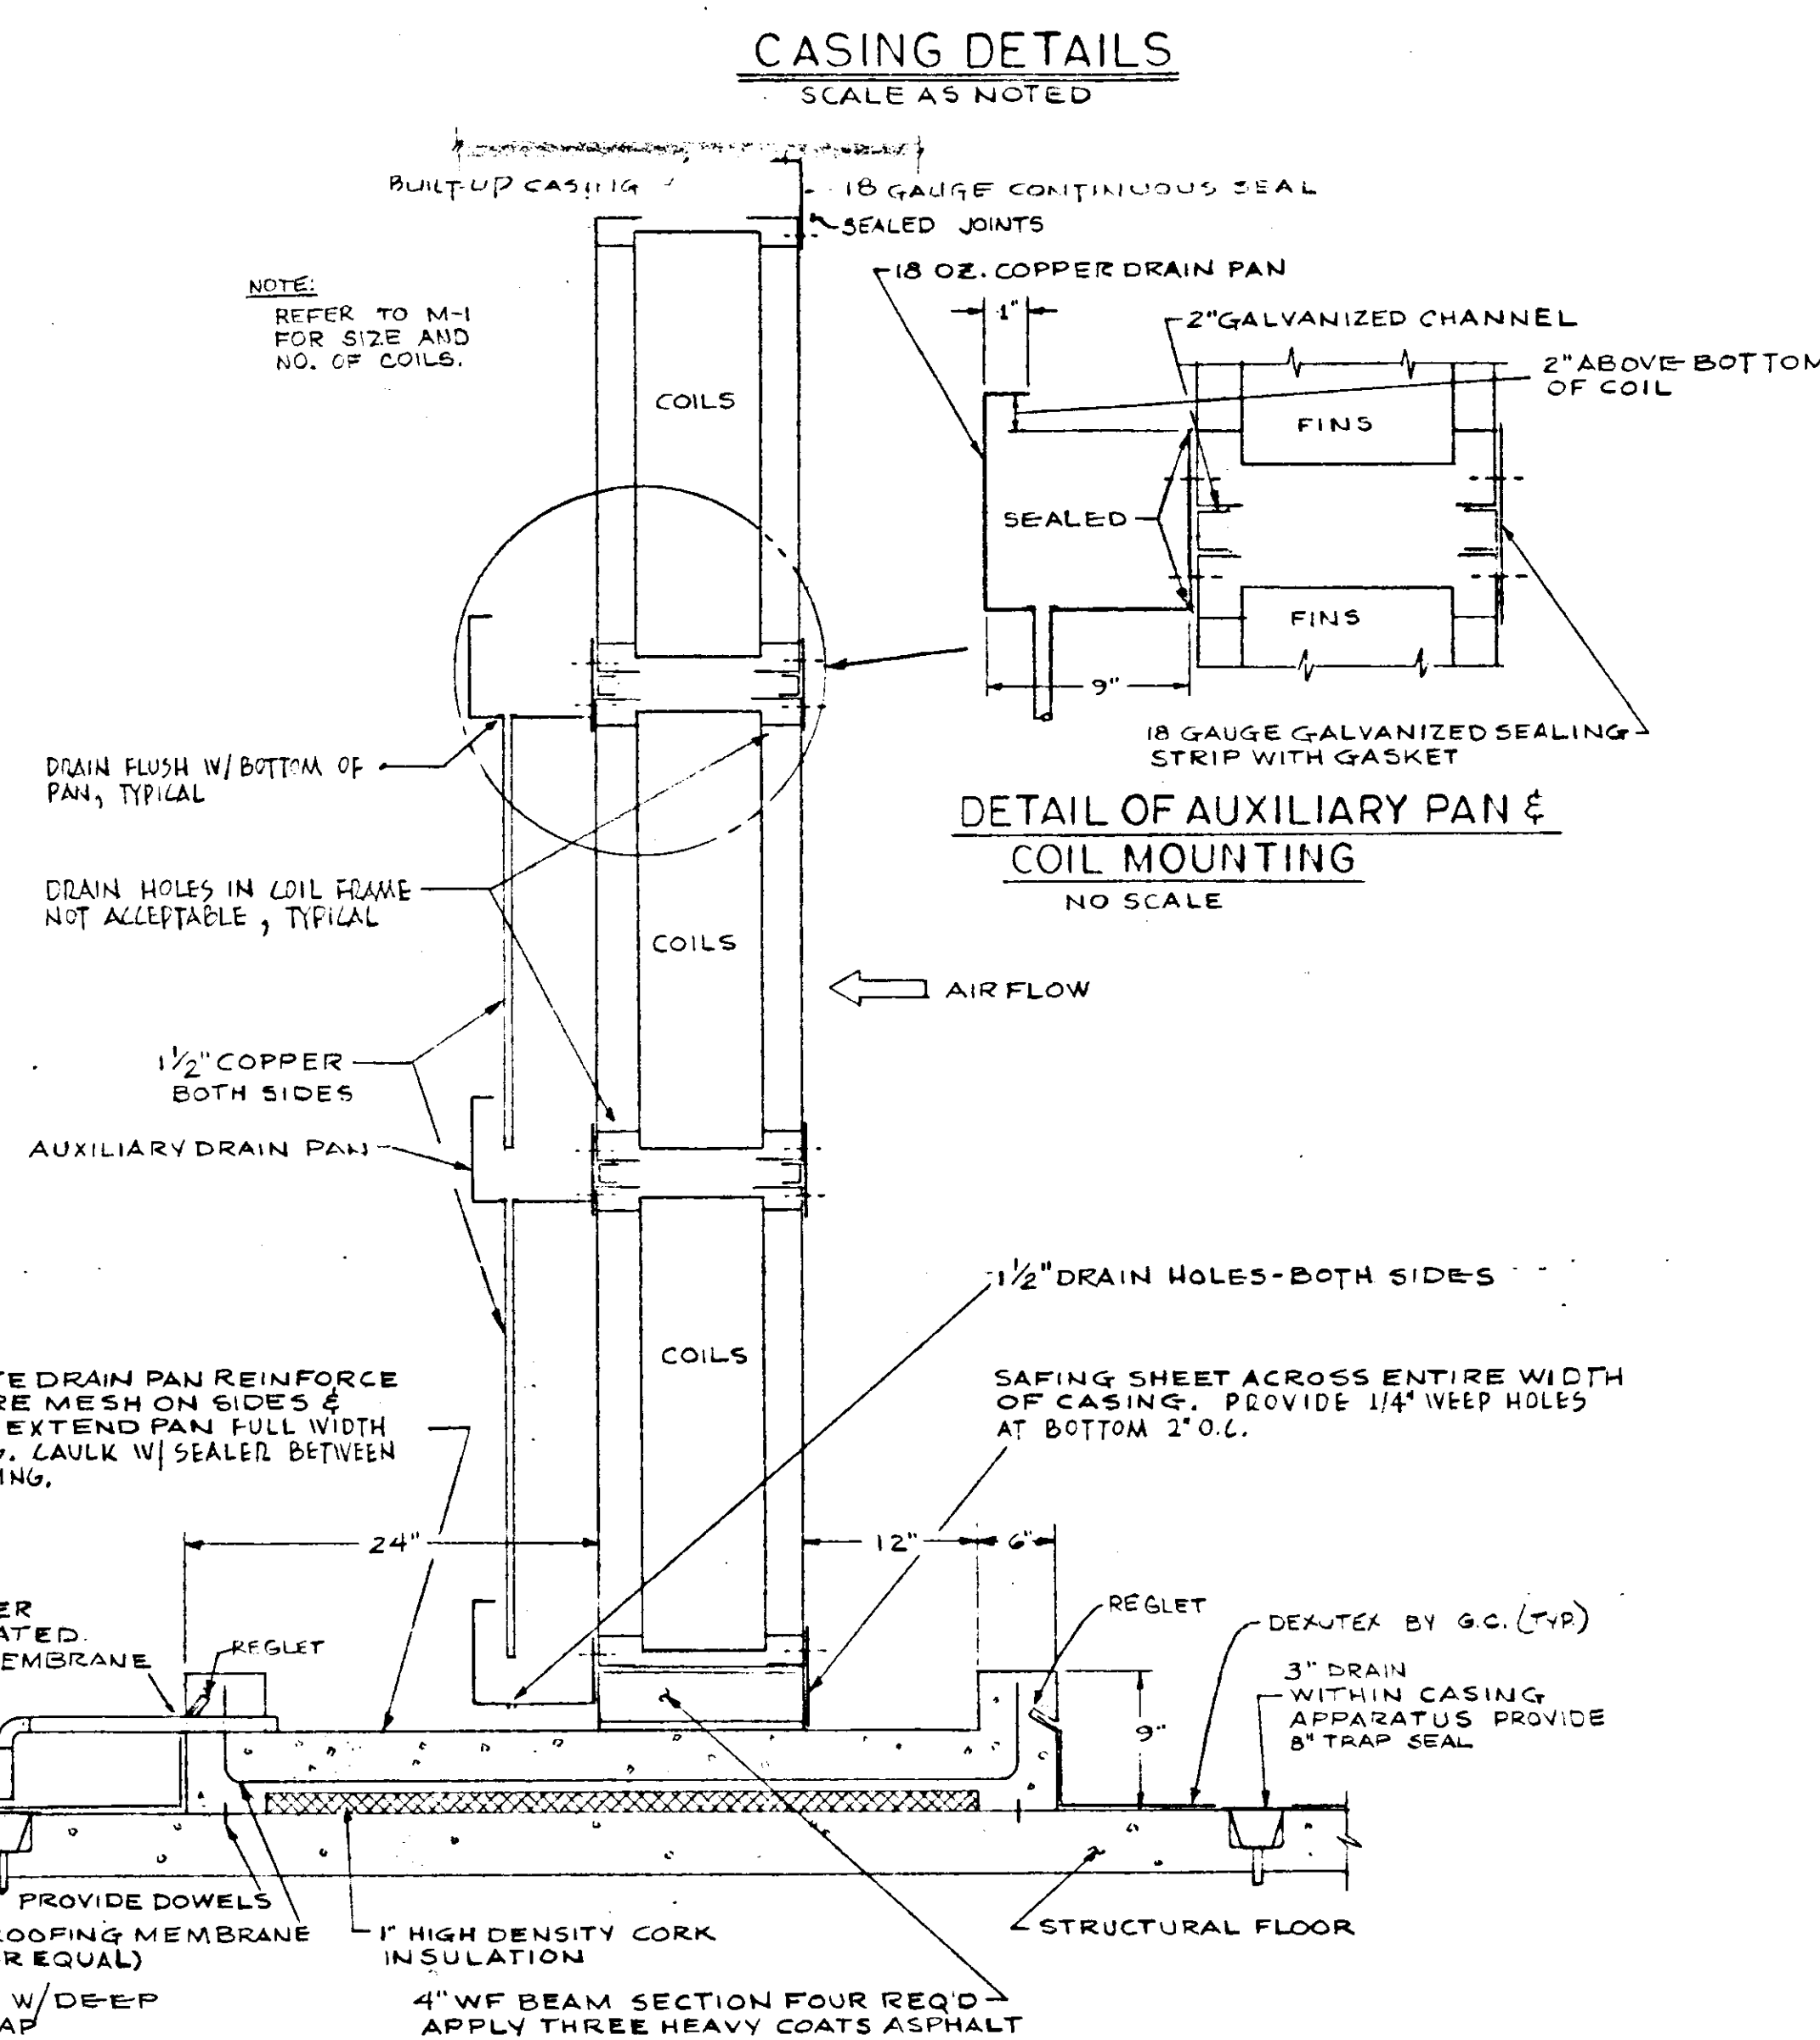
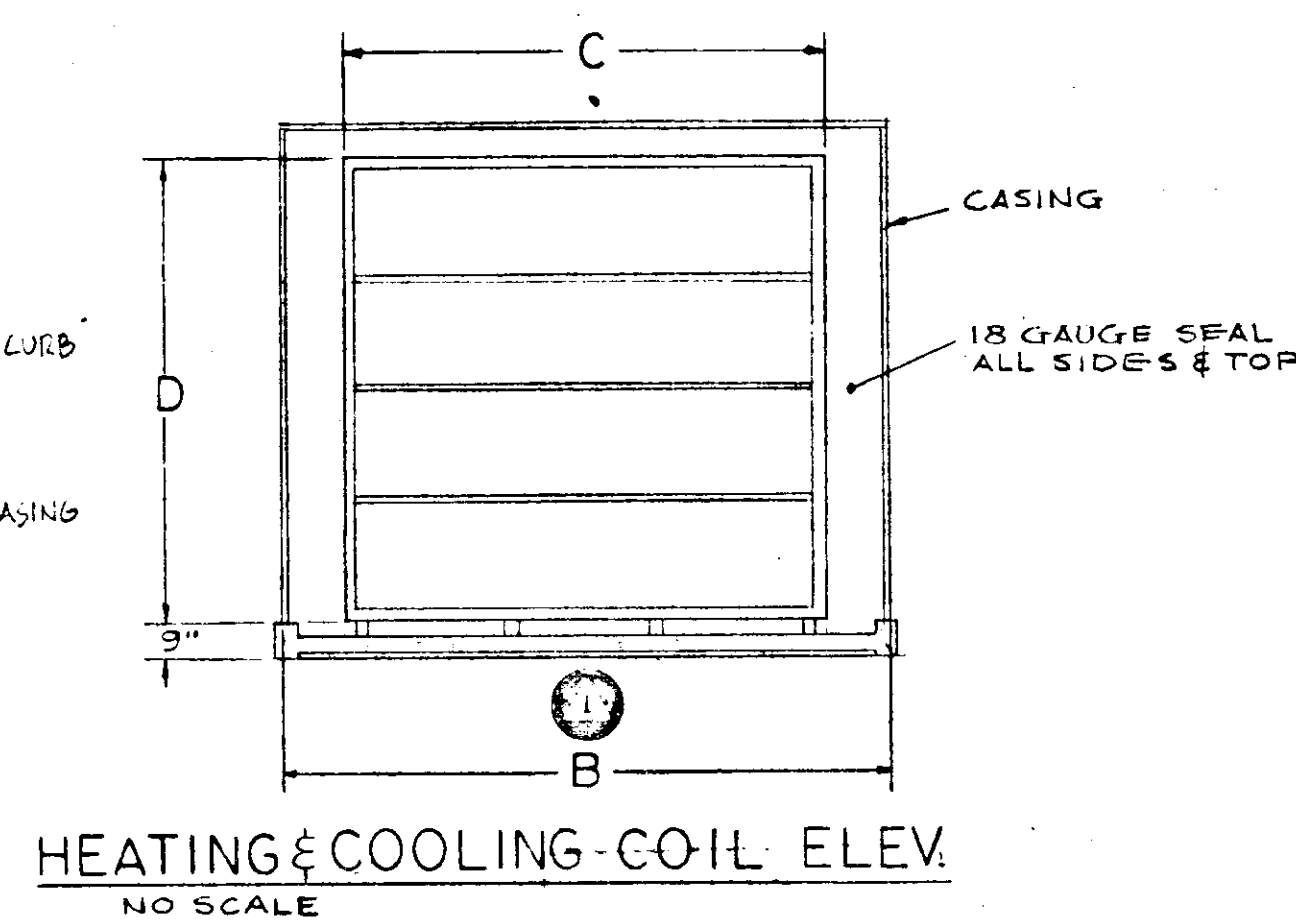
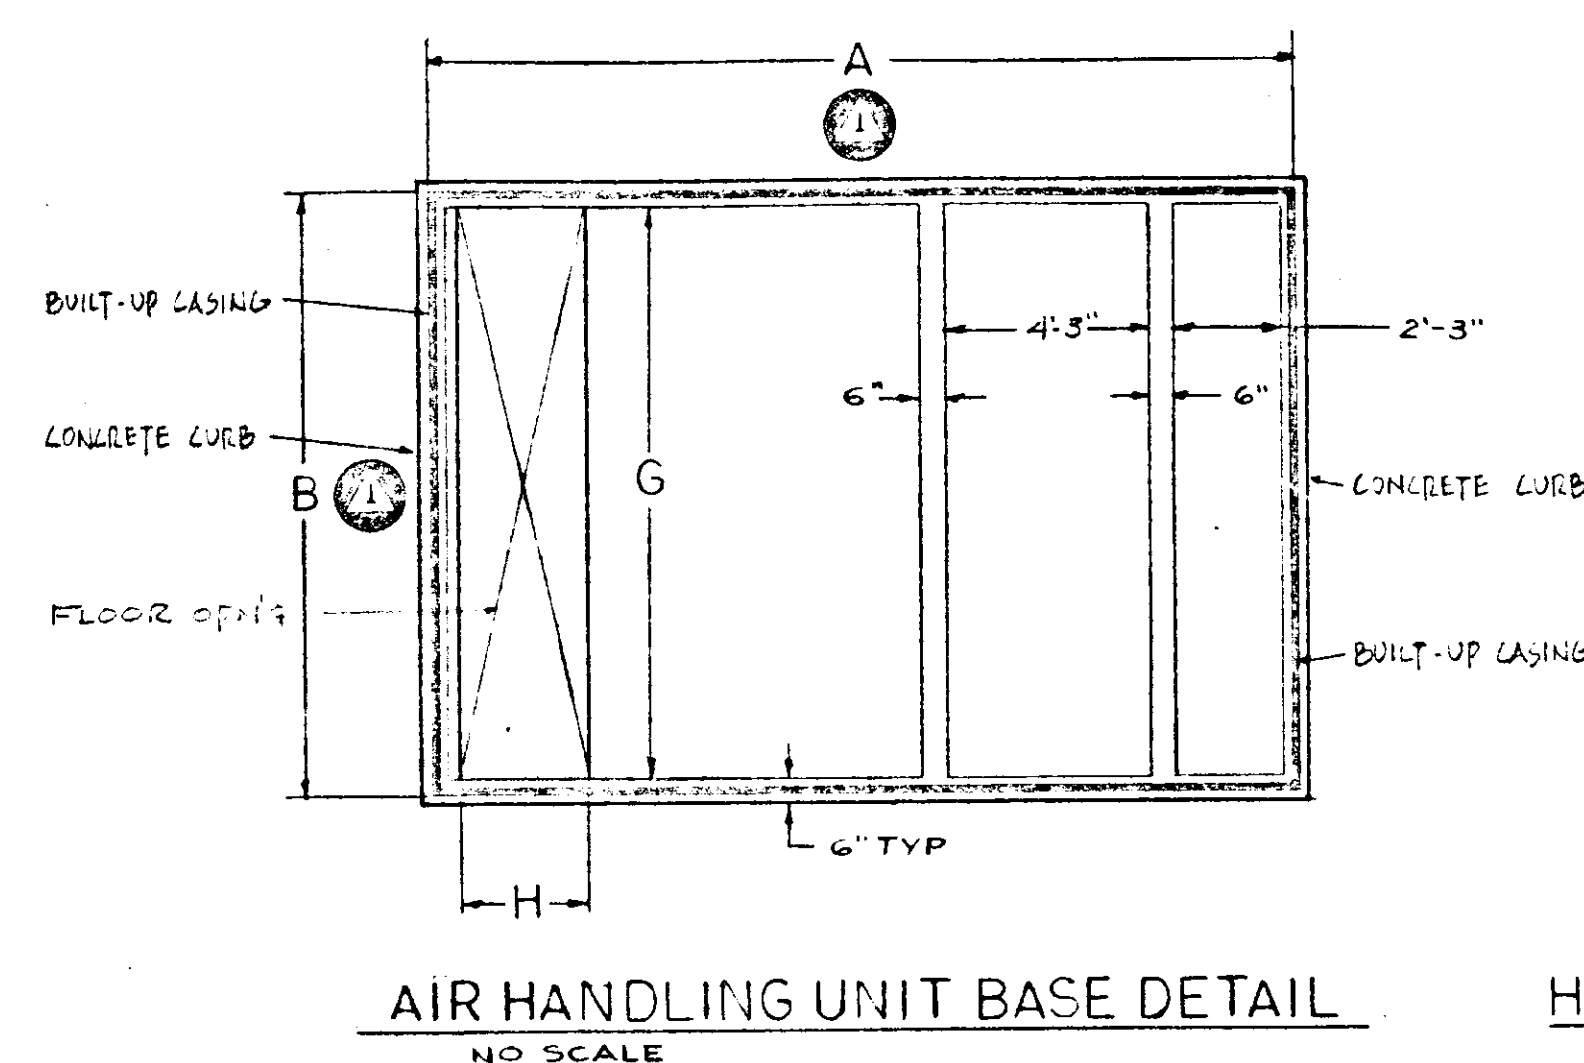
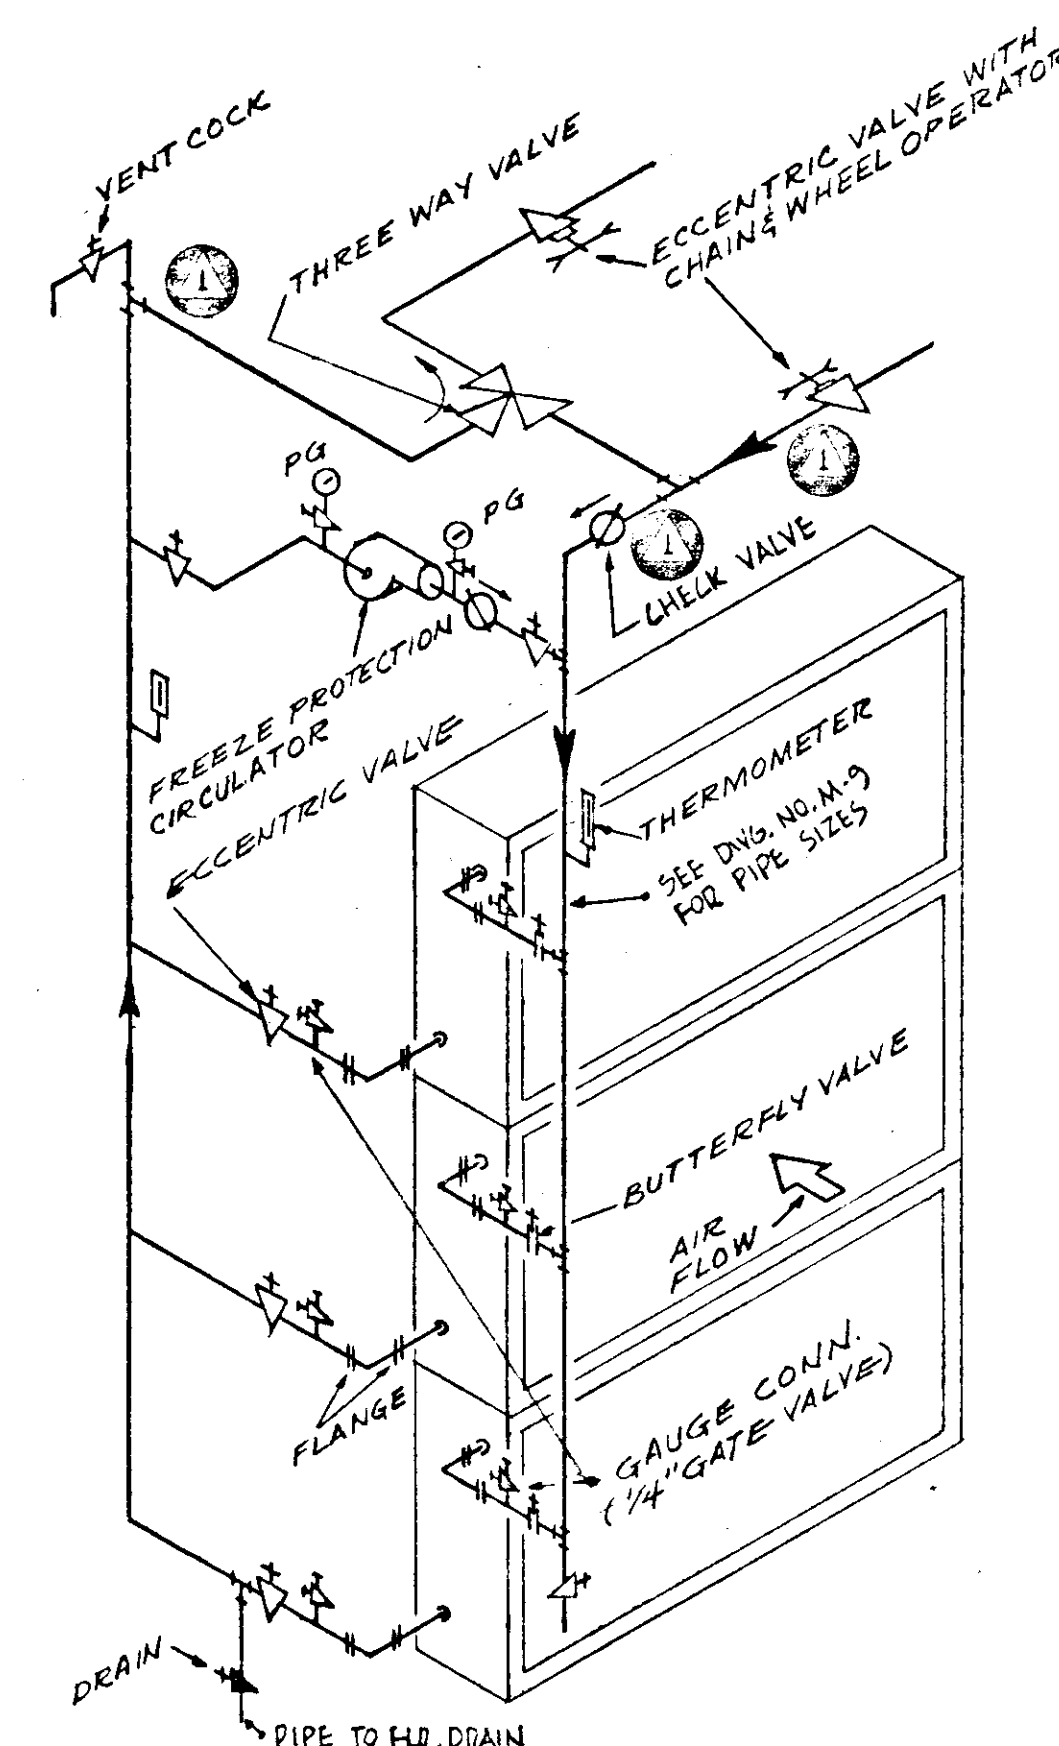
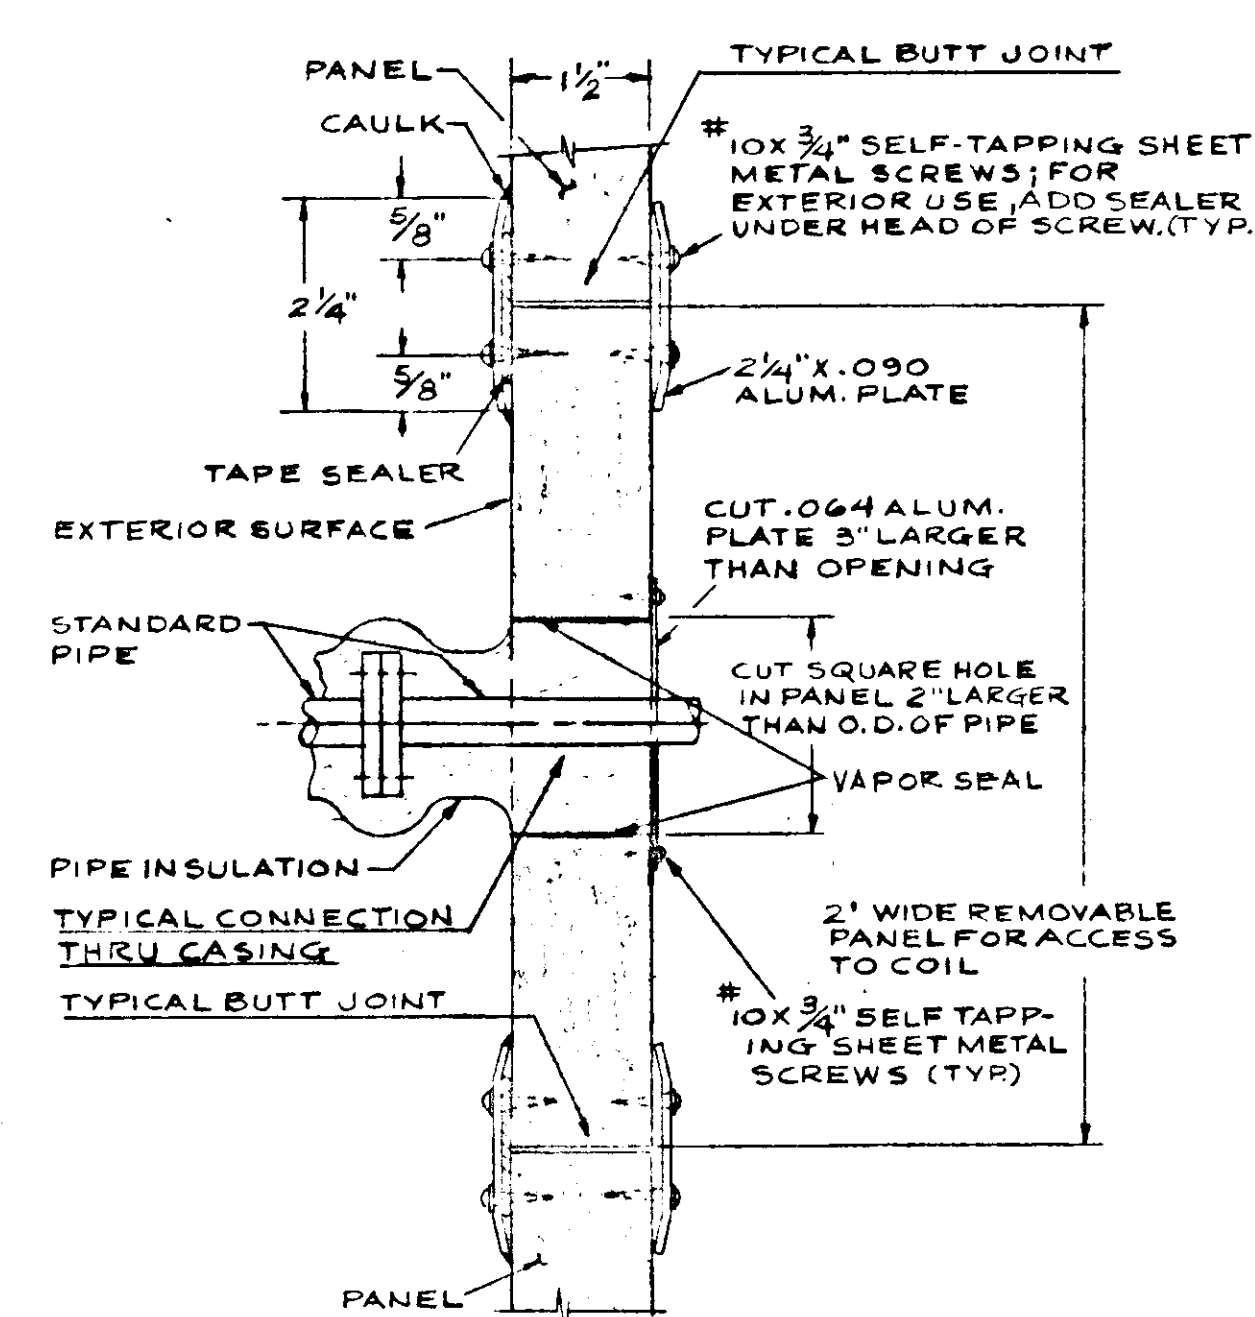
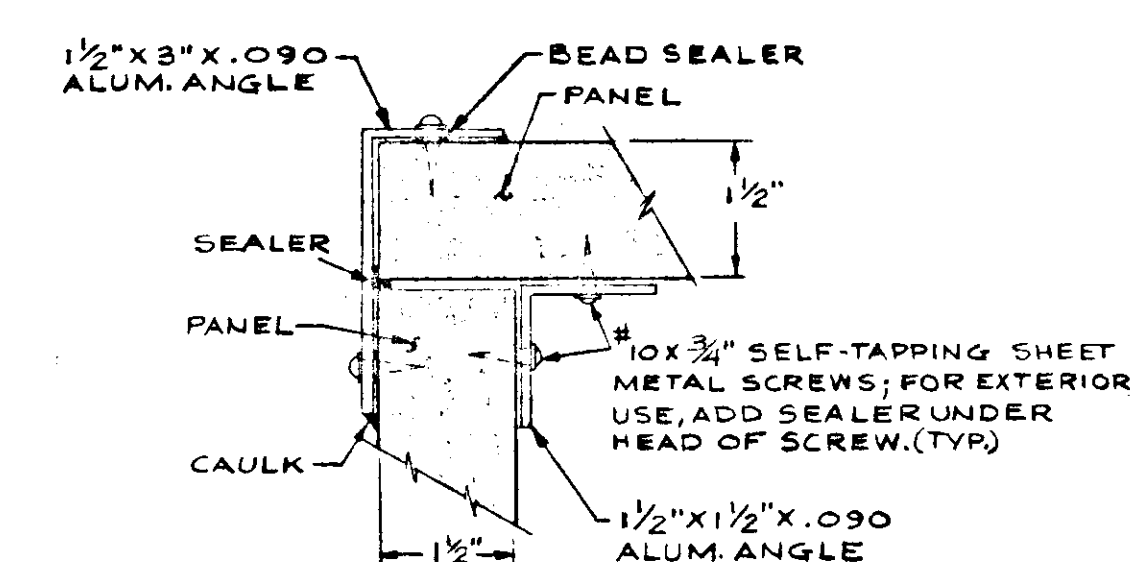
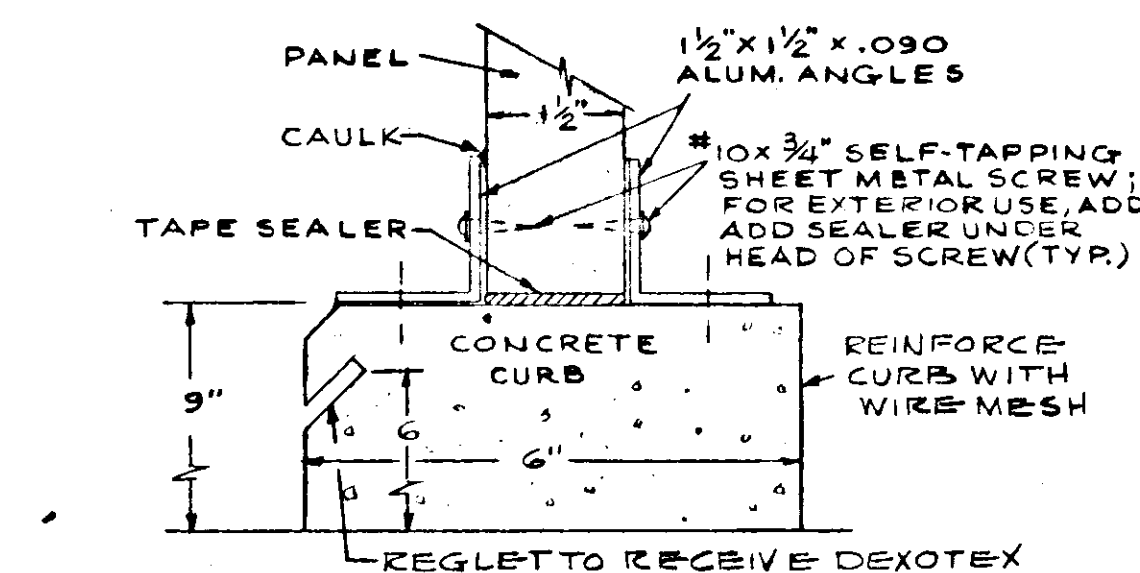
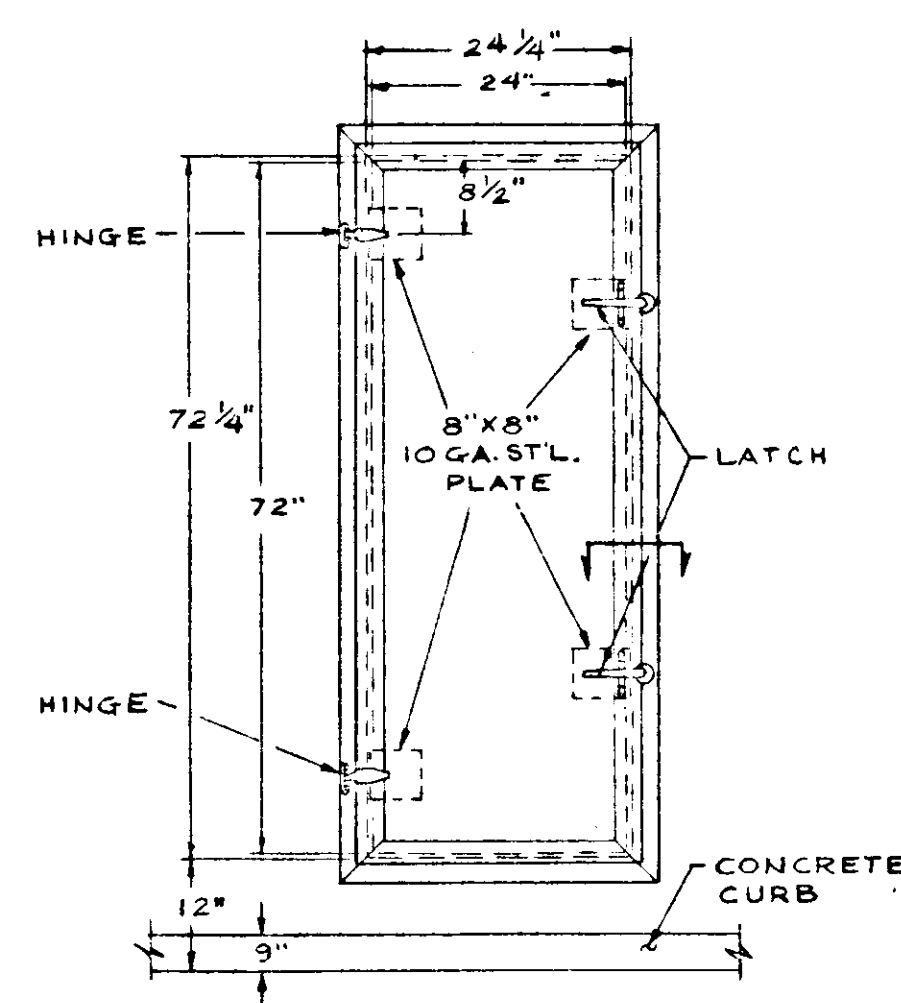
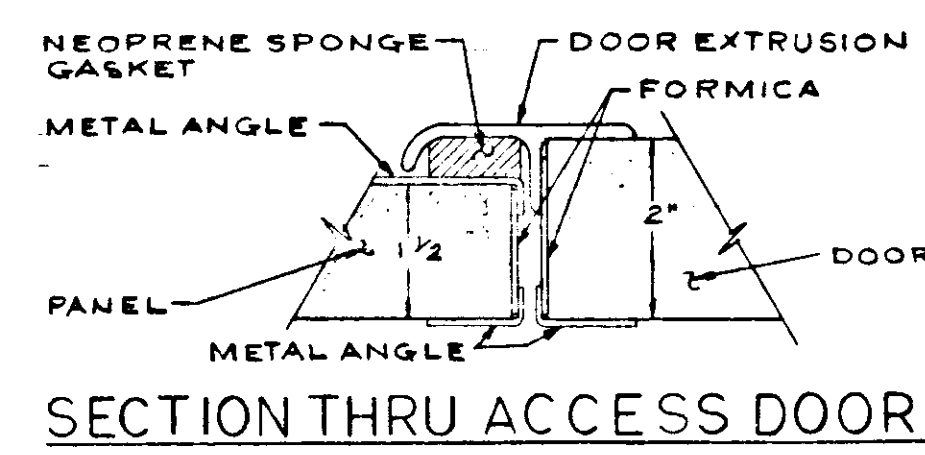
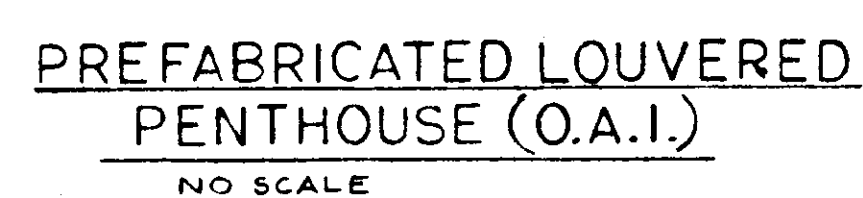


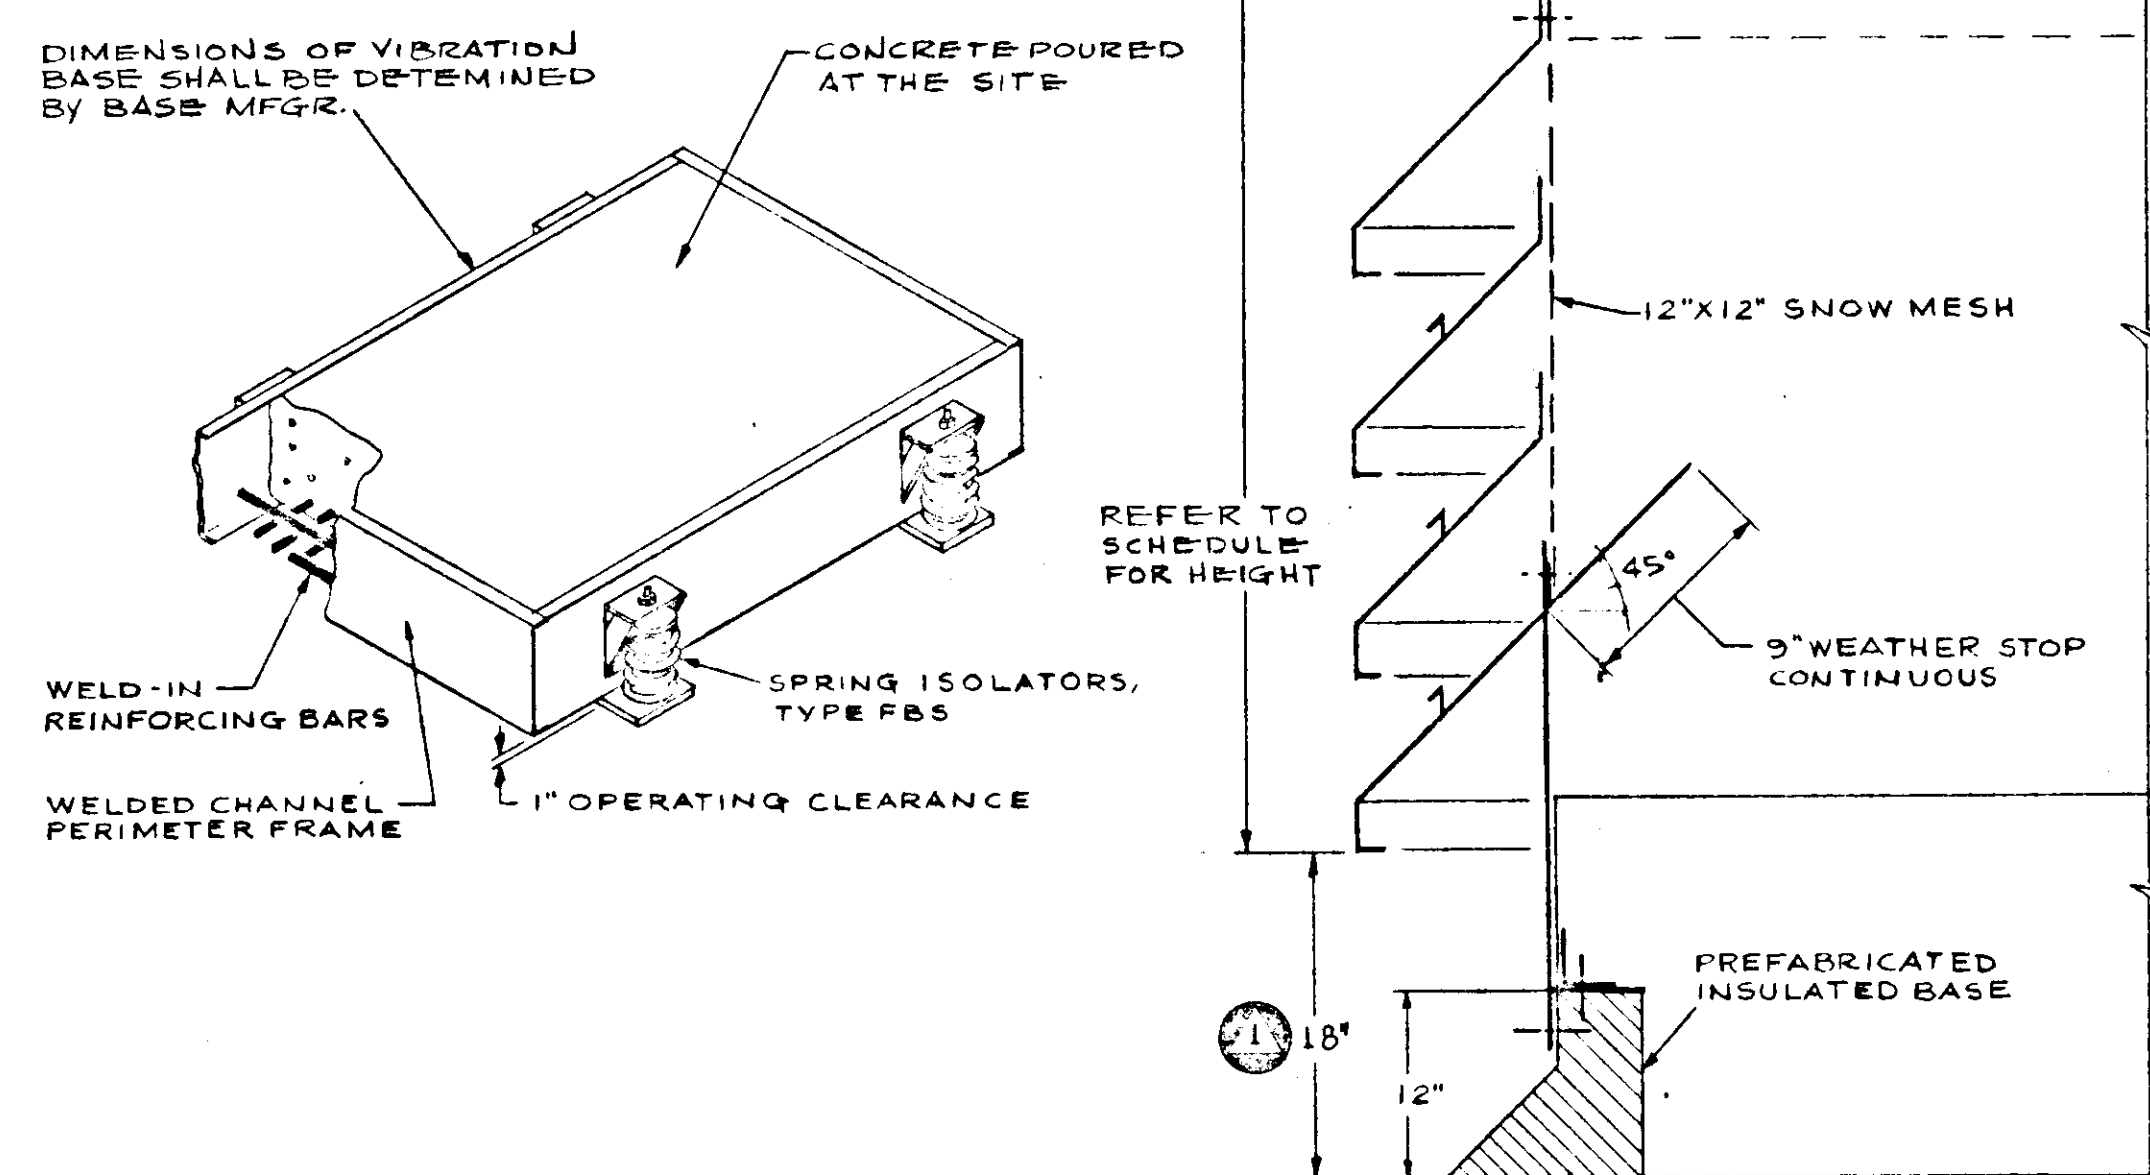

COMPONENT DIMENSIONS								
UNIT NO.	A	B	C	D	E	F	G	H
AH #1	18'-4"	12'-4"	10'-0"	12'-0"	10'-0"	12'-8"	12'-0"	4'-0"
AH #2	18'-4"	12'-4"	10'-0"	12'-0"	10'-0"	12'-8"	12'-0"	4'-0"
AH #3	17'-4"	9'-4"	7'-0"	9'-0"	8'-0"	9'-8"	4'-0"	4'-0"
AH #4	19'-6"	12'-10"	10'-6"	12'-0"	12'-0"	12'-8"	—	—

NOTE:

1. VERIFY ALL EQUIPMENT DIMENSIONS PRIOR TO FABRICATION OF CASING AND CONSTRUCTION OF BASE. DIMENSIONS SHOWN ARE QUOTE OR CLOSE TO DIMENSIONS
2. NUMBER OF COILS AND FILTER SECTIONS VARY. REFER TO SCHEDULES ON M-1
3. JOINTS BETWEEN CASING SIDES AND TOPS SHALL BE CLOSED WITH 18 GAUGE GALVANIZED STEEL SEAL SHALL BE SECURED TO CASING AND COMPONENTS. JOINTS SHALL BE SEALED WITH SAME MATERIAL AS CASING. JOINTS

BUILT UP COMPONENTS
SCALE AS NOTED